

Idaho Department of Environmental Quality Reuse Permit M-263-01

Mayfield Sewer and Water Corporation (Mayfield Springs Planned Community; hereafter “permittee”) is hereby authorized to construct, install, and operate a reuse facility in accordance with (1) this permit; (2) IDAPA 58.01.17 “Recycled Water Rules”; (3) an approved plan of operation; and (4) all other applicable federal, state, and local laws, statutes, and rules. This permit is effective from the date of signature and expires on October 4, 2028.



10/4/22

Signature

Date

Aaron Scheff

Regional Administrator
Boise Regional Office
Idaho Department of Environmental Quality

Idaho Department of Environmental Quality
Boise Regional Office
1445 N Orchard St.
208-373-0550

This page intentionally left blank for correct double-sided printing.

Table of Contents

1. Common Acronyms/Abbreviations and Definitions	5
2. Facility Information	7
3. Compliance Schedule for Required Activities.....	9
4. Permit Limits and Conditions	12
4.1 Management Unit Descriptions	12
4.2 Hydraulic Loading Limits.....	12
4.3 Constituent Loading Limits – <i>Not Required</i>	12
4.4 Management Unit Buffer Zones – <i>Not Required</i>	12
4.5 Other Permit Limits and Conditions	13
5. Monitoring Requirements	16
5.1 Recycled Water Sampling and Analyses	16
5.1.1 Constituent Monitoring.....	16
5.1.2 Management Unit and Other Flow Monitoring.....	17
5.2 Ground Water Monitoring	17
5.2.1 Ground Water Monitoring Point Descriptions	17
5.2.2 Ground Water Monitoring, Sampling, and Analyses	18
5.3 Soil Monitoring – <i>Not Required</i>	18
5.4 Crop Monitoring – <i>Not Required</i>	18
5.5 Lagoon Information	18
6. Reporting Requirements	19
6.1 Annual Report Requirements.....	19
6.1.1 Due Date	19
6.1.2 Required Contents	19
6.1.3 Submittals	20
6.2 Emergency and Noncompliance Reporting	21
7. Reserved.....	22
8. Standard Permit Conditions	22
9. General Permit Conditions.....	24
9.1 Operations	24
9.1.1 Backflow Prevention	24
9.1.2 Restricted to Premises	24
9.1.3 Health Hazards, Nuisances, and Odors Prohibited.....	25
9.1.4 Solids Management	25
9.1.5 Temporary Cessation of Operations and Closure (IDAPA 58.01.17.801).....	26
9.1.6 Plan of Operation (IDAPA 58.01.17.300.05).....	26
9.1.7 Seepage Testing Requirements (IDAPA 58.01.16.493.02.c).....	26
9.1.8 Ground Water Quality Rule (IDAPA 58.01.11).....	27
9.2 Administrative.....	27
9.2.1 Permit Modification (IDAPA 58.01.17.700).....	27
9.2.2 Permit Transferable (IDAPA 58.01.17.800)	27
9.2.3 Permit Revocation (IDAPA 58.01.17.920)	27
9.2.4 Violations (IDAPA 58.01.17.930).....	28
9.2.5 Severability	28

10. Other Applicable Laws	29
10.1 Owner Responsibilities for Well Use and Maintenance	29
10.1.1 Well Use	29
10.1.2 Well Maintenance.....	29
10.1.3 Wells Posing a Threat to Human Health and Safety or Causing Contamination of the Ground Water Resource	29
11. Site Maps	30
11.1 Regional Map.....	30
11.2 Facility Map.....	31

1. Common Acronyms/Abbreviations and Definitions

CA	compliance activity
BOD ₅	5-day biochemical oxygen demand
DEQ	Idaho Department of Environmental Quality
DEQ Guidance	DEQ Guidance for Reclamation and Reuse of Municipal and Industrial Wastewater, latest revision
Director	DEQ director or designee unless otherwise specified
E _i	irrigation efficiency
EPA	United States Environmental Protection Agency
FM	prefix for flow measurement/monitoring location, device, or method reporting serial number
GW	prefix for ground water reporting serial number
IDAPA	Numbering designation for all administrative rules in Idaho promulgated according to the Idaho Administrative Procedure Act
IDWR	Idaho Department of Water Resources
IPDES	Idaho Pollutant Discharge Elimination System
IWR	irrigation water requirement — any combination of wastewater and supplemental irrigation water applied at rates commensurate to the moisture requirements of the crop, and calculated monthly during the growing season.
lb	pound
LG	prefix for lagoon reporting serial number
material change	a change in a document required by this permit that would impact DEQ's ability to ensure compliance and protect human health and the environment
µmhos/cm	micromhos per centimeter
MG	million gallons
mg/L	milligram per liter
mJ/cm ²	millijoule per square centimeter
mL	milliliter
MU	management unit, prefix for management unit reporting environmental serial number
NWRI	National Water Research Institute
NTU	nephelometric turbidity unit
N	nitrogen

NVDS	non-volatile dissolved solids
ppm	parts per million
P	phosphorus
PO	plan of operation
QAPP	quality assurance project plan
Responsible Official	facility contact person authorized by the permittee to communicate with DEQ on behalf of the permittee on any matter related to the permit, including without limitation, the authority to communicate with and receive notices from DEQ regarding notices of violation or non-compliance, permit violations, permit enforcement, and permit revocation. The responsible official provides written certification of permit application materials, annual report submittals, and other information submitted to DEQ as required by the permit. Any notice to or communication with the responsible official is considered a notice to or communication with the permittee. The responsible official may designate an authorized representative to act as the facility contact person for any of the activities or duties related to the permit, except signing and certifying the permit application, which must be done by the responsible official. The authorized representative shall act as the responsible official and shall bind the permittee as described in this definition. Designation of the authorized representative shall follow the requirements specified in section 6.1.3 of the permit.
RW	prefix for recycled water reporting serial number
TDS	total dissolved solids
UV	ultraviolet
VDS	volatile dissolved solids
WRF	Water Research Foundation
WW	prefix for wastewater reporting serial number
yr	year

2. Facility Information

Information Type	Information Specific to This Permit
Class of recycled water	Municipal, Class A recycled water
Method of treatment and reuse	Membrane Bioreactor (MBR), UV disinfection, common area irrigation and ground water recharge. Screw press sludge dewatering. Estimated 179 MG per year average flow at buildout. 87 total acres proposed for common area irrigation.
Collection and treatment system classification	Wastewater collection system classification: Class I Wastewater treatment system classification: Class III
Facility location	Approximate facility location: 43.373032°N, 115.970671°W Township 1N, Range 4E, Section 34
Facility mailing address	Mayfield Sewer and Water Corporation 1861 S. Wells Ave, Suite 210 Meridian, ID 83642
Facility responsible official and authorized representative	Responsible Official: Gregory B. Johnson, Owner Mayfield Sewer and Water Corporation 1861 S. Wells Ave, Suite 210 Meridian, ID 83642 greg@westparkco.com Authorized Representative: Future Wastewater Treatment Plant Operator, as designated on most current Form A: Responsible Official / Duly Authorized Representative Designation Form Notify DEQ within 30 days if a change in personnel occurs for any of the facility contacts. DEQ will issue a minor permit modification to confirm the change.
Ground water	A deep regional aquifer is found at a depth of 350-500 feet below ground surface and flows to the southwest.

Surface water	<p>Indian Creek is located approximately 1 mile north. Beneficial uses: cold water biota, secondary contact recreation (IDAPA 58.01.02.140.12 HUC 17050114 Unit SW-3d)</p> <p>Indian Creek Reservoir approximately 2 miles northwest. Beneficial uses: cold water biota, primary contact recreation (IDAPA 58.01.02.140.12 HUC 17050114 Unit SW-3c)</p> <p>Also agricultural water supply, industrial water supply, wildlife habitats, and aesthetics apply to all surface waters of the state. (IDAPA 58.01.02.100.03, 04, and 05).</p>
---------------	--

3. Compliance Schedule for Required Activities

Compliance Activity (CA) Number and Completion Due Date	Compliance Activity Description
<p>CA-263-01</p> <p>Submittal required 18 months after permit issue date.</p>	<p>Plan of Operation (PO): The permittee shall submit to DEQ for review and approval a PO that reflects current operations and incorporates the requirements of this permit. The PO shall comply with the applicable requirements stated in IDAPA 58.01.17.300.05 and shall address applicable items in the most current PO Checklist available.</p> <p>The PO shall include the following site management plans or the permittee may submit the site management plans individually:</p> <ol style="list-style-type: none">1. Emergency operating plan2. Runoff management plan3. Waste solids management plan4. Ground water recharge basin management plan5. Ground water monitoring plan6. Irrigation management and education plan7. Off-specification water procedure <p>The PO shall be updated as needed to reflect current operations. The permittee shall notify DEQ of material changes to the PO and copies shall be kept on site and made available to DEQ upon request.</p>

Compliance Activity (CA) Number and Completion Due Date	Compliance Activity Description
<p>CA-263-02</p> <p>Submittal required 18 months after permit issue date.</p>	<p>Quality Assurance Project Plan (QAPP): The permittee shall prepare and implement a QAPP that incorporates all monitoring and reporting required by this permit. A copy of the QAPP along with written notice that the permittee has implemented the QAPP shall be provided to DEQ. The permittee must follow the QAPP when collecting, analyzing, and reporting monitoring data submitted to DEQ.</p> <p>The QAPP shall be designed to assist in planning for collecting, analyzing, and reporting all monitoring in support of this permit and in explaining data anomalies when they occur. At a minimum, the QAPP must include the following:</p> <ol style="list-style-type: none"> 1. Details on the number of measurements, number of samples, type of sample containers, preservation of samples, holding times, analytical methods, analytical detection and quantitation limits for each target compound, type and number of quality assurance field samples, precision and accuracy requirements, sample preparation requirements, sample shipping methods, and laboratory data delivery requirements 2. Maps indicating the location of each monitoring and sampling point 3. Qualification and training of personnel 4. Names, addresses, and telephone numbers of the laboratories used by or proposed to be used by the permittee 5. Example formats and tables that will be used by the permittee to summarize and present all data in the annual report <p>The format and content of the QAPP should adhere to the recommendations and references in the Quality Assurance and Data Processing sections of the DEQ Guidance.</p> <p>The permittee shall amend the QAPP whenever there is a modification in sample collection, sample analysis, or other procedure addressed by the QAPP. The permittee shall notify DEQ of material changes to the QAPP and copies shall be kept on site and made available to DEQ upon request.</p>

Compliance Activity (CA) Number and Completion Due Date	Compliance Activity Description				
CA-263-03 As specified	<p>Seepage Testing: The following table shows the date by which the permittee shall complete seepage testing on the specified lagoons:</p> <table border="1" data-bbox="444 457 1425 583"> <tr> <td data-bbox="444 457 938 520">Lagoon:</td> <td data-bbox="938 457 1425 520">Seepage Test Due Date:</td> </tr> <tr> <td data-bbox="444 520 938 583">LG-263-01</td> <td data-bbox="938 520 1425 583">Prior to being put into service</td> </tr> </table> <p>Submit to DEQ for review and approval a proposed schedule and procedure for performing the required seepage tests at least 45 days before the planned seepage test. The seepage test procedures shall be sealed by the Idaho licensed professional engineer or professional geologist in responsible charge for the test.</p> <p>Seepage tests shall be completed according to the procedures approved by DEQ. The seepage test report shall be sealed by the Idaho licensed professional engineer or professional geologist in responsible charge and submitted to DEQ within 90 days after completion of the seepage test.</p> <p>Allowable seepage rates can be found in IDAPA 58.01.16.493.03. Requirements for lagoons leaking above the allowable amount are outlined in IDAPA 58.01.16.493.04.</p>	Lagoon:	Seepage Test Due Date:	LG-263-01	Prior to being put into service
Lagoon:	Seepage Test Due Date:				
LG-263-01	Prior to being put into service				
CA-263-04 Prior to recycled water use	<p>UV Disinfection Validation: UV disinfection system performance validation testing shall be conducted in conformance to NWRI and WRF guidance. This guidance should be used to develop a UV disinfection spot-check commissioning testing performance validation testing procedure capable of verifying that the performance of the installed UV disinfection system fulfills project design goals. The testing procedure should be submitted to DEQ for review and acceptance at least 45 days prior to planned testing. The performance validation testing procedure must include all proposed testing protocols, along with a Quality Assurance Project Plan (QAPP) that clearly defines quality objectives. The procedure must define the roles and responsibilities of each entity involved with the validation. After acceptance of the testing protocol, the permittee shall conduct the testing and submit a report documenting the testing results to DEQ for review and approval.</p>				
CA-263-05 12 months prior to permit expiration	<p>Ground Water Monitoring Well Network Analysis: the permittee shall submit an analysis of the existing ground water monitoring well network to DEQ for review and approval. The analysis shall be prepared and submitted concurrently with the CA-263-07 (Permit Renewal Application) The analysis shall assess the monitoring well network's ability to provide adequate ground water quality data, to assess potential mounding effects in the groundwater recharge area, and to characterize the impacts of ground water recharge activities and identify any monitoring well network deficiencies.</p> <p>The analysis shall propose monitoring well network improvements for any identified deficiencies and include an implementation schedule for proposed improvements. Should the analysis propose to install, replace, or abandon any monitoring wells, the permittee shall submit plans and specifications in accordance with the construction plans requirement listed in Section 4.5.</p>				

Compliance Activity (CA) Number and Completion Due Date	Compliance Activity Description
CA-263-06 18 Months prior to permit expiration	Pre-application Conference: If the permittee intends to continue operating the reuse facility beyond the expiration date of this permit, the permittee shall contact DEQ and schedule a pre-application conference to discuss the compliance status of the facility and the content required for the reuse permit application package.
CA-263-07 12 months prior to permit expiration	Permit Renewal Application: The permittee shall submit to DEQ a complete permit renewal application package that fulfills the requirements specified in CA-263-05 and identified at the pre-application conference.

4. Permit Limits and Conditions

4.1 Management Unit Descriptions

Serial Number	Description	Maximum Acres ^a Allowed
MU-263-01	Common Landscape Areas	87
MU-263-02	Ground Water Recharge Basins	Not Applicable

a. Maximum acres represent the total permitted acreage of the MU as provided by the permittee.

4.2 Hydraulic Loading Limits

Serial Number	Growing Season Hydraulic Loading	Nongrowing Season Maximum Hydraulic Loading
MU-263-01	Not Applicable (N/A)	Not Allowed
MU-263-02	N/A	N/A

4.3 Constituent Loading Limits – *Not Required*

4.4 Management Unit Buffer Zones – *Not Required*

4.5 Other Permit Limits and Conditions

Category	Permit Limits and Conditions
Growing season	March 1 through October 31 (245 days)
Nongrowing season	November 1 through February 28/29 (120/121 days)
Reporting year for annual loading rates	November 1 through October 31
Operator certification and endorsement	The wastewater treatment facility shall be operated by personnel certified and licensed in the State of Idaho wastewater operator training program at the operator class level specified in IDAPA 58.01.16.203 and properly trained to operate and maintain the system.
Disinfection limits in recycled water	<p>Class A: The median number of total coliform organisms shall not exceed 2.2 total coliform organisms/100 mL, as determined from the bacteriological results of the last seven days for which analyses have been completed. No sample shall exceed 23 total coliform organisms/100 mL in any confirmed sample.</p> <p>The UV disinfection process, when combined with filtration, shall demonstrate achieving 5-log inactivation of virus.</p>
Turbidity limits in treated effluent prior to disinfection	<ul style="list-style-type: none"> • Daily arithmetic mean of all measurements of turbidity shall not exceed 0.2 NTU • Turbidity shall not exceed 0.5 NTU at any time <p>When the continuous turbidity measurements are above the instantaneous limit for more than five minutes, filtered effluent shall be automatically diverted until such time as the effluent is below the instantaneous limit.</p>
pH	Between 6.0 and 9.0
Total nitrogen	Total nitrogen shall not exceed 10 mg/L based on a monthly arithmetic mean as determined from weekly composite sampling.
Five (5) Day Biochemical Oxygen Demand (BOD ₅)	BOD ₅ shall not exceed five (5) mg/L based on a monthly arithmetic mean as determined from weekly composite sampling.
Posting	<p>When using Class A recycled water for irrigation, notify the public and personnel in the area that recycled water is used and is not safe for drinking. Post signs stating “Caution: Recycled Water - Do Not Drink” or equivalent signage.</p> <p>A posted signage plan to notify the public of the proximate use of Class A recycled water shall be submitted to DEQ for approval concurrent with construction plan and specification review for each development phase.</p>

Category	Permit Limits and Conditions
Fencing	MU-263-01: No fencing required MU-263-02: Ground water recharge basins must be fully fenced to prohibit public access.
Construction plans	Pursuant to Idaho Code §39-118, IDAPA 58.01.16, and IDAPA 58.01.17, detailed plans and specifications shall be submitted to DEQ for review and approval before construction, modification, or expansion of any wastewater treatment, storage, conveyance structures, ground water monitoring wells, or reuse facility. Inspection requirements shall be satisfied, and within 30 days of completion of construction, the permittee shall submit as-built plans or a letter from an Idaho professional engineer certifying the facilities or structures were constructed in substantial accordance with the approved plans and specifications.
Records retention requirements	Keep records generated to meet the requirements of this permit for the duration of the permit, including administrative extensions, plus two years.
Access	Drinking fountains, picnic tables, food establishments, and other public eating facilities shall be placed out of any spray irrigation area in which Class A recycled water is used or shall be otherwise protected from contact with the Class A recycled water.
Flow meter calibration/verification	Document the flow measurement calibration/verification of all flow meters and pumps used directly or indirectly to measure recycled water when such devices are used to assess or demonstrate compliance. Calibration/verification of flow measurement devices shall be done in accordance with the device manufacturer's specifications and with the permittee's QAPP.
Backflow prevention and testing requirements	Backflow prevention is required to protect surface water and ground water from an unauthorized discharge of recycled water or wastewater. Refer to section 9.1.1 of this permit.
Pumping facilities identification and signage	<ul style="list-style-type: none"> • All exposed and above ground piping, risers, fittings, pumps, valves, etc., shall be painted purple color (Pantone 512, 522 or other equivalent product acceptable to DEQ). In addition, all piping shall be identified using an accepted means of labeling reading "Caution: Recycled Water - Do Not Drink" or equivalent signage in both Spanish and English. In a fenced pump station area, signs shall be posted on the fence on all sides. • Designated facilities using Class A recycled water from a pumping facility, such as, but not limited to, controller panels and washdown or blow-off hydrants on water trucks, hose bibs, and temporary construction services, shall have warning labels installed. The labels shall read, "Caution: Recycled Water - Do Not Drink" or equivalent signage, in both Spanish and English.

Category	Permit Limits and Conditions
Distribution system identification and signage	<ul style="list-style-type: none">• Permittee shall implement requirements for private piping connected to permittee's distribution system.• All new buried pipe conveying Class A Recycled Water, including service lines, valves, and other appurtenances, shall be colored purple, and the precise color used, e.g., Pantone 512, 522 or equivalent, shall be consistently used throughout the system. The precise color proposed for use shall be identified in plans and specifications. If fading or discoloration of the purple pipe is experienced during construction, identification tape or locating wire along the pipe is required. Label piping every ten (10) feet "Caution: Recycled Water - Do Not Drink" or equivalent signage in both Spanish and English.• If identification tape is installed along with the purple pipe, it shall be prepared with white or black printing on a purple color field as approved by DEQ, having the words, "Caution: Recycled Water - Do Not Drink" or equivalent signage in both Spanish and English. The overall width of the tape shall be at least three (3) inches. Identification tape shall be installed eighteen (18) inches above the transmission pipe longitudinally, shall be centered over the pipe, and shall run continuously along the length of the pipe.• All new valves shall have locking valve covers that are non-interchangeable with potable water valve covers, and shall have an inscription cast on the top surface stating "Recycled Water" or equivalent.• All above ground pipes and pumps shall be consistently color coded (purple) and marked to differentiate Class A recycled water facilities from potable water facilities.• The permittee shall maintain detailed and up to date maps of the distribution system.

5. Monitoring Requirements

5.1 Recycled Water Sampling and Analyses

5.1.1 Constituent Monitoring

Monitoring Point Serial Number and Location	Sample Description	Sample Type and Frequency	Constituents (mg/L unless otherwise specified)
WW-263-01 Wastewater influent	Wastewater Influent	Grab/monthly (during periods of use)	total nitrogen, as N BOD ₅
WW-263-02 Prior to disinfection	Filtered effluent prior to disinfection	Continuous monitoring with a recorded value every 15 minutes	turbidity, NTU pH (standard units)
WW-263-03 During disinfection	Filtered effluent during disinfection	Continuous monitoring with a recorded value every 15 minutes	UV Dose (mJ/cm ²)
RW-263-01 After disinfection, prior to storage	Class A Recycled water	Grab/daily	total coliform (organisms/100 mL)
		Composite/weekly	total nitrogen, as N BOD ₅
		Grab/quarterly for one year following start-up	TDS VDS NVDS (as calculated)

5.1.2 Management Unit and Other Flow Monitoring

Management Unit or Flow Measurement Serial Number and Location	Sample Description	Sample Type and Frequency	Parameters, each MU or FM
FM-263-01 Influent flow to headworks	Influent wastewater flow	Daily meter reading Monthly compilation of data	Volume (MG/month) Volume (MG/year)
FM-263-02 Flow from storage tank to irrigation system	Recycled water flow to MU-263-01	Daily meter reading Monthly compilation of data	Volume (MG/month) Volume (MG/year)
FM-263-03 Flow from storage tank to ground water recharge basins	Recycled water flow to MU-263-02	Daily meter reading Monthly compilation of data	Volume (MG/month) Volume (MG/year)
FM-263-04 Supplemental irrigation flow to storage tank	Supplemental irrigation flow to storage tank	Daily meter reading Monthly compilation of data	Volume (MG/month) Volume (MG/year)
FM-263-05 Flow to off-specification pond	Off-specification water flow to LG-263-01	Daily meter reading Monthly compilation of data	Volume (gal/day) Volume (MG/year)

5.2 Ground Water Monitoring

5.2.1 Ground Water Monitoring Point Descriptions

Monitoring Point Serial Number	Common Designation	Well Type	Location
GW-263-01	MW 1	Monitoring well	Northwest of ground water recharge area.
GW-263-02	MW 2	Monitoring well	Southwest of ground water recharge area.
GW-263-03	MW 3	Monitoring well	Southeast of ground water recharge area.

5.2.2 Ground Water Monitoring, Sampling, and Analyses

Monitoring Point Serial Number	Sampling Point Description	Sample Type and Frequency	Constituents (mg/L unless otherwise specified)
GW-263-01 through GW-263-03	Monitoring wells	Unfiltered grab sample/twice annually (unless otherwise specified): April and October	Water table elevation (feet) Water table depth (feet) Water table depth to surface (feet) pH (Standard Units) Nitrate-nitrogen, as N Total dissolved solids

5.3 Soil Monitoring – *Not Required*

5.4 Crop Monitoring – *Not Required*

5.5 Lagoon Information

Serial number	Description	Surface Area, sf	Maximum Operating Volume, gallons	Liner Type
LG-263-01	Off-specification water storage lagoon	4,454	100,000	60-mil HDPE

6. Reporting Requirements

6.1 Annual Report Requirements

The permittee shall submit to DEQ an annual report prepared by a competent environmental professional covering the previous reporting year.

6.1.1 Due Date

The annual report is due no later than January 31 of each year, which shall cover the previous reporting year.

6.1.2 Required Contents

The annual report shall include the following:

1. Detailed results of the required monitoring as described in section 5 of this permit. The report shall present all monitoring data in summary tables to expedite review. If the permittee monitors any parameter for compliance purposes more frequently than required by this permit, the results of this monitoring shall be included in the calculation and reporting of the data submitted in the annual report.
2. A brief interpretive discussion of the results of all required monitoring data as specified by section 5. The discussion shall address data quality objectives, validation, and verification; explain what the data say about permit compliance; and reuse facility environmental impacts. The reporting year for this permit is specified in section 4.5.
3. Status of all work described in section 3 of this permit.
4. Results of all backflow testing, repairs, and replacements required by section 9.1.1 of this permit.
5. Discussion of major maintenance activities such as major equipment replacement, lagoon liner maintenance, and wastewater treatment and reuse facility maintenance.
6. A summary of all noncompliance events that occurred during the reporting year. Examples of noncompliance events that must be discussed include, but are not limited to: exceedance of permit limits, complaints, missed monitoring events, incorrect monitoring dates or frequencies, dry monitoring wells, uncontained spills causing runoff, construction without DEQ engineering plan approval, construction without engineering inspection, and reporting incorrect acreage.
7. Laboratory analytical reports that show results, analytical methods, and practical quantitation limits for monitoring specified in section 5 of the permit. Chain of custody forms, supporting information for laboratory analytical reports, and quality assurance documentation shall be available for review upon request by DEQ.
8. The calculations and results for the parameters in the following table:

Monitoring Point Serial Number	Parameter (Calculate for each MU)	Units
MU-263-01 MU-263-02	Monthly arithmetic mean of total nitrogen concentration in recycled water	mg/L per month
	Monthly arithmetic mean of BOD ₅ concentration in recycled water	mg/L per month
	Daily median number of total coliform organisms determined by the bacteriological results of the last 7 days for which analysis were completed	Total coliform organisms per 100 mg/L
	Daily arithmetic mean of turbidity	NTU
Other Reporting Requirements: <ul style="list-style-type: none"> • Annually identify all active recycled water common space irrigation sites and associated acreages, with maps delineating sites. Acreages may be estimates. • Provide all required reporting provided to IDWR in accordance with any groundwater monitoring-reporting plan(s) associated with Water Right No. 63-32225. 		

6.1.3 Submittals

All applications, annual reports, or other information submitted to DEQ as required by this permit shall be signed and certified as follows:

- Permit applications shall be signed by the responsible official as described below:
 - For a corporation by a responsible corporate officer
 - For a partnership or sole proprietorship by a general partner or the proprietor, respectively
 - For a municipality, state, federal, Indian tribe, or other public agency by either the principal executive officer, ranking elected official, or a person of decision-making authority who can legally bind the permittee with respect to the permit.
- Annual reports and other information required by this permit shall be signed by the responsible official or by a duly authorized representative of that person. A person is a duly authorized representative only if all of the following are true:
 - The authorization is made in writing by the responsible official.
 - The authorization specifies either an individual or position having responsibility for the overall operation of the regulated facility, such as the position of plant manager, superintendent, position of equivalent responsibility, or an individual having overall responsibility for environmental matters for the company.
 - The written authorization is submitted to DEQ.

Submit all applications, annual reports, and other information required by this permit to the following DEQ regional office at this address:

Engineering Manager
 Idaho Department of Environmental Quality
 Boise Regional Office
 1445 N Orchard St
 Boise, Idaho 83706

The annual report, or any other data or monitoring information submitted to DEQ, shall include the following certification statement and be signed, dated, and certified by the permittee's Responsible Official or duly Authorized Representative:

"I certify that the information provided in this submittal was prepared in conformance with the Quality Assurance Project Plan required by this permit and is to the best of my knowledge, true, accurate and complete and I acknowledge that knowing submission of false or incomplete information may result in permit revocation as provided for in IDAPA 58.01.17.920.01 or other enforcement action as provided for under Idaho law."

Permit applications shall include the following certification statement and be signed, dated, and certified by the permittee's Responsible Official:

"I certify that the information provided in this submittal is, to the best of my knowledge, true, accurate and complete and I acknowledge that knowing submission of false or incomplete information may result in permit revocation as provided for in IDAPA 58.01.17.920.01, non-issuance of the permit, or other enforcement action as provided for under Idaho law."

Other information submitted to DEQ as required by the permit shall include the above certification statement and be signed, dated, and certified by the permittee's Responsible Official or duly Authorized Representative.

6.2 Emergency and Noncompliance Reporting

The permittee shall report noncompliance incidents to DEQ's regional office at (208) 373-0550 or toll free at (888) 800-3480.

The permittee may also be required to report unauthorized discharges to surface waters to DEQ's IPDES program. The DEQ IPDES hotline is (833) IPDES24 or (833) 473-3724.

In case of public health emergencies, the permittee should call the 24-hour Idaho Emergency Medical Services Communications Center number at (800) 632-8000.

Section 8 of this permit and IDAPA 58.01.17.500.06 provide the reporting requirements for facilities.

The permittee shall report all instances of permit non-compliance that may endanger public health or the environment and unauthorized discharges to surface waters of the State of Idaho to DEQ's regional office by telephone (phone numbers provided in this section) within 24 hours from the time the permittee becomes aware of these events at the phone numbers provided in this section.

The permittee shall provide a written follow-up to the DEQ regional office within five days from the time the permittee became aware of the permit non-compliance or unauthorized discharge.

7. Reserved

8. Standard Permit Conditions

The following standard permit conditions are included as terms of this permit as required by the “Recycled Water Rules,” (IDAPA 58.01.17.500).

500. STANDARD PERMIT CONDITIONS.

The following conditions shall apply to and be included in all permits. (4-1-88)

01. **Compliance Required.** The permittee shall comply with all conditions of the permit. (4-1-88)
02. **Renewal Responsibilities.** If the permittee intends to continue operation of the permitted facility after the expiration of an existing permit, the permittee shall apply for a new permit in accordance with these rules. (4-1-88)
03. **Operation of Facilities.** The permittee shall at all times properly maintain and operate all structures, systems, and equipment for treatment, control and monitoring, which are installed or used by the permittee to achieve compliance with the permit or these rules. (4-1-88)
04. **Provide Information.** The permittee shall furnish to the Director within a reasonable time, any information including copies of records, which may be requested by the Director to determine whether cause exists for modifying, revoking, re-issuing, or terminating the permit, or to determine compliance with the permit or these rules. (4-1-88)
05. **Entry and Access.** The permittee shall allow the Director, consistent with Title 39, Chapter 1, Idaho Code, to:
 - a. Enter the permitted facility. (4-1-88)
 - b. Inspect any records that must be kept under the conditions of the permit. (4-1-88)
 - c. Inspect any facility, equipment, practice, or operation permitted or required by the permit. (4-1-88)
 - d. Sample or monitor for the purpose of assuring permit compliance, any substance or any parameter at the facility. (4-1-88)
06. **Reporting.** The permittee shall report to the Director under the circumstances and in the manner specified in this section: (4-1-88)
 - a. In writing at least thirty (30) days before any planned physical alteration or addition to the permitted facility or activity if that alteration or addition would result in any significant change in information that was submitted during the permit application process. When the alteration or addition results in a need for a major modification, such alteration or addition shall not be made prior to Department approval issued in accordance with these rules. (4-7-11)
 - b. In writing thirty (30) days before any anticipated change which would result in noncompliance with any permit condition or these rules. (4-1-88)
 - c. Orally within twenty-four (24) hours from the time the permittee became aware of any noncompliance which may endanger the public health or the environment at telephone numbers provided in the permit by the Director. (4-1-88)

d. In writing as soon as possible but within five (5) days of the date the permittee knows or should know of any noncompliance unless extended by the Department. This report shall contain: (4-1-88)

i. A description of the noncompliance and its cause; (4-1-88)

ii. The period of noncompliance including to the extent possible, times and dates and, if the noncompliance has not been corrected, the anticipated length of time it is expected to continue; and (4-7-11)

iii. Steps taken or planned, including timelines, to reduce or eliminate the continuance or reoccurrence of the noncompliance. (4-7-11)

e. In writing as soon as possible after the permittee becomes aware of relevant facts not submitted or incorrect information submitted, in a permit application or any report to the Director. Those facts or the correct information shall be included as a part of this report. (4-1-88)

07. Minimize Impacts. The permittee shall take all necessary actions to eliminate and correct any adverse impact on the public health or the environment resulting from permit noncompliance. (4-1-88)

08. Compliance with “Ground Water Quality Rule.” Permits issued pursuant to these rules shall require compliance with IDAPA 58.01.11, “Ground Water Quality Rule.” (4-7-11)

9. General Permit Conditions

The following general permit conditions are based on the cited rules at the time of issuance and are enforceable as part of this permit. Note that the rules cited in this section, and elsewhere in this permit, are supplemented by the rules themselves. Rules applicable to your facility are enforceable whether or not they appear in this permit.

9.1 Operations

9.1.1 Backflow Prevention

Reuse facilities with existing or planned cross-connections or interconnections between the recycled water system and any water supply (potable or nonpotable) or surface water, shall have backflow prevention assemblies, devices, or methods as required by applicable rule or as specified in this permit and approved by DEQ.

For public water systems, backflow assemblies shall meet the requirements of IDAPA 58.01.08.543. Assemblies shall be adequately maintained and shall be tested annually by a certified backflow assembly tester, and repaired or replaced as necessary to maintain operational status.

For domestic water supply wells, backflow prevention devices shall meet the requirements of IDAPA 07.02.04 and shall be adequately operated and maintained.

Irrigation water supply wells shall meet the requirements of IDAPA 37.03.09.36 for preventing any waste or contamination of the ground water resource. Backflow prevention assemblies or devices used to protect the ground water shall be adequately operated and maintained.

Discharge of recycled water to surface water is regulated by the DEQ or EPA. An IPDES or NPDES permit is required for any discharge to surface water and backflow prevention shall be implemented to prevent any unauthorized discharge. Backflow prevention assemblies or devices used to protect surface water shall be adequately operated and maintained.

Records of all testable backflow assembly test results, repairs, and replacements shall be kept at the reuse facility along with other operational records, and shall be discussed in the annual report and made available for inspection by DEQ. Other approved means of backflow prevention, such as siphons and air-gap structures that cannot be tested, shall be maintained in operable order.

9.1.2 Restricted to Premises

Wastewaters or recharge waters applied to the land surface must be restricted to the premises of the application site. Wastewater discharges to surface water require an IPDES or NPDES permit (IDAPA 58.01.16.600.02).

9.1.3 Health Hazards, Nuisances, and Odors Prohibited

Health hazards, nuisances, and odors are prohibited as follows:

Wastewater must not create a public health hazard or nuisance condition (IDAPA 58.01.16.600.03).

No person shall allow, suffer, cause, or permit the emission of odorous gases, liquids, or solids into the atmosphere in such quantities as to cause air pollution (IDAPA 58.01.01.776.01).

Air Pollution defined as the presence in the outdoor atmosphere of any air pollutant or combination thereof in such quantity of such nature and duration and under such conditions as would be injurious to human health or welfare, to animal or plant life, or to property, or to interfere unreasonably with the enjoyment of life or property (IDAPA 58.01.01.006.06).

9.1.4 Solids Management

Biosolids are the nutrient-rich organic materials resulting from the treatment of sewage sludge. When treated and processed, sewage sludge becomes biosolids that can be safely recycled and applied as fertilizer to sustainably improve and maintain productive soils and stimulate plant growth.

Biosolids generated from sewage sludge are regulated by DEQ or EPA under 40 CFR Part 503 and require a DEQ-approved sludge disposal plan as outlined in IDAPA 58.01.16.650. Contact DEQ before to applying biosolids at any permitted reuse facility.

Sludge is the semi-liquid mass produced and removed by wastewater treatment processes. This does not include grit, garbage, and large solids.

Sludge may be generated by wastewater treatment processes at municipal and industrial facilities. A DEQ-approved sludge disposal plan, as outlined in IDAPA 58.01.16.650, may be required.

Solid waste is any garbage or refuse, sludge from a waste water treatment plant, water supply treatment plant, or air pollution control facility and other discarded material including solid, liquid, semi-solid, or contained gaseous material resulting from industrial, commercial, mining, and agricultural operations and from community activities, but does not include solid or dissolved materials in domestic sewage, or solid or dissolved material in irrigation return flows or industrial discharges that are point sources subject to permits under Section 402 of the Federal Water Pollution Control Act, as amended or source, special nuclear, or by-product material as defined by the Atomic Energy Act of 1954, as amended.

Solid waste does not include inert wastes, manures and crop residues ultimately returned to the soils at agronomic rates, and any agricultural solid waste that is managed and regulated pursuant to rules adopted by the Idaho Department of Agriculture. DEQ reserves the right to use existing authorities to regulate agricultural waste that impacts human health or the environment.

Solid waste is regulated under the “Solid Waste Management Rules” (IDAPA 58.01.06). Wastes otherwise regulated by DEQ (i.e., this permit) are not regulated under IDAPA 58.01.06.

Waste solids include sludge and wastes otherwise regulated by DEQ according with IDAPA 58.01.06.001.03.a.xii. Waste solids may include vegetative waste, silt and mud containing organic matter, and other non-inert solid wastes.

Inert wastes are defined as non-combustible, nonhazardous, and non-putrescible solid wastes that are likely to retain their physical and chemical structure and have a de minimis potential to generate leachate under expected conditions of disposal, which includes resistance to biological attack.

Waste solids require a DEQ-approved sludge disposal plan as outlined in IDAPA 58.01.16.650.

9.1.5 Temporary Cessation of Operations and Closure (IDAPA 58.01.17.801)

Temporary cessation of operations and closure must be addressed as follows:

01. Temporary Cessation. A permittee shall implement any applicable conditions specified in the permit for temporary cessation of operations. When the permit does not specify applicable temporary cessation conditions, the permittee shall notify the Director prior to a temporary cessation of operations at the facility greater than sixty (60) days in duration and any cessation not for regular maintenance or repair. Cessation of operations necessary for regular maintenance or repair of a duration of sixty (60) days or less are not required to notify the Department under this section. All notifications required under this section shall include a proposed temporary cessation plan that will ensure the cessation of operations will not pose a threat to human health or the environment. (4-7-11)

02. Closure. A closure plan shall be required when a facility is closed voluntarily and when a permit is revoked or expires. A permittee shall implement any applicable conditions specified in the permit for closure of the facility. Unless otherwise directed by the terms of the permit or by the Director, the permittee shall submit a closure plan to the Director for approval at least ninety (90) days prior to ceasing operations. The closure plan shall ensure that the closed facility will not pose a threat to human health and the environment. Closure plan approval may be conditioned upon a permittee's agreement to complete such site investigations, monitoring, and any necessary remediation activities that may be required. (4-7-11)

9.1.6 Plan of Operation (IDAPA 58.01.17.300.05)

The PO must comply with the following:

05. Reuse Facility Operation and Maintenance Manual or Plan of Operations. A facility's operation and maintenance manual must contain all system components relating to the reuse facility in order to comply with IDAPA 58.01.16 "Wastewater Rules," Section 425. Manuals and manual amendments are subject to the review and approval provision therein. In addition to the content required by IDAPA 58.01.16.425, manuals for reuse facilities shall include, if applicable: operation and management responsibility, permits and standards, general plant description, operation and control of unit operations, land application site maps, wastewater characterization, cropping plan, hydraulic loading rate, constituent loading rates, compliance activities, seepage rate testing, site management plans, monitoring, site operations and maintenance, solids handling and processing, laboratory testing, general maintenance, records and reports, store room and inventory, personnel, an emergency operating plan, and any other information required by the Department. (4-7-11)

9.1.7 Seepage Testing Requirements (IDAPA 58.01.16.493.02.c)

Subsequent Tests. All lagoons covered under these rules must be seepage tested by an Idaho licensed professional engineer, an Idaho licensed professional geologist, or by individuals under their supervision every ten (10) years after the initial testing. (5-8-09)

9.1.8 Ground Water Quality Rule (IDAPA 58.01.11)

The permittee shall comply with the requirements of the “Ground Water Quality Rule” (IDAPA 58.01.11).

9.2 Administrative

Requirements for administration of the permit are defined as follows.

9.2.1 Permit Modification (IDAPA 58.01.17.700)

01. Modification of Permits. A permit modification may be initiated by the receipt of a request for modification from the permittee, or may be initiated by the Department if one (1) or more of the following causes for modification exist: (4-7-11)

a. Alterations. There are material and substantial alterations or additions to the permitted facility or activity which occurred after permit issuance which justify the application of permit conditions that are different or absent in the existing permit. (4-7-11)

b. New standards or regulations. The standards or regulations on which the permit was based have been changed by promulgation of amended standards or regulations or by judicial decision after the permit was issued. (4-7-11)

c. Compliance schedules. The Department determines good cause exists for modification of a compliance schedule or terms and conditions of a permit. (4-7-11)

d. Non-limited pollutants. When the level of discharge of any pollutant which is not limited in the permit exceeds the level which may cause an adverse impact to surface or ground waters. (4-7-11)

e. To correct technical mistakes, such as errors in calculation, or mistaken interpretations of law made in determining permit conditions. (4-7-11)

f. When a treatment technology proposed, installed, and properly operated and maintained by the permittee fails to achieve the requirements of the permit. (4-7-11)

9.2.2 Permit Transferable (IDAPA 58.01.17.800)

01. General. A permit may be transferred only upon approval of the Department. No transfer is required for a corporate name change as long as the secretary of state can verify that a change in name alone has occurred. An attempted transfer is not effective for any purpose until approved in writing by the Department. (4-7-11)

9.2.3 Permit Revocation (IDAPA 58.01.17.920)

01. Conditions for Revocation. The Director may revoke a permit if the permittee violates any permit condition or these rules, or the Director becomes aware of any omission or misrepresentation of condition or information relied upon when issuing the permit. (4-7-11)

02. Notice of Revocation. Except in cases of emergency, the Director shall issue a written notice of intent to revoke to the permittee prior to final revocation. Revocation shall become final within thirty-five (35) days of receipt of the notice by the permittee, unless within that time the permittee requests an administrative hearing in writing. The hearing shall be conducted in accordance with IDAPA 58.01.23, Rules of Administrative Procedure

before the Board of Environmental Quality.”

(5-3-03)

03. Emergency Action. If the Director finds the public health, safety or welfare requires emergency action, the Director shall incorporate findings in support of such action in a written notice of emergency revocation issued to the permittee. Emergency revocation shall be effective upon receipt by the permittee. Thereafter, if requested by the permittee in writing, the Director shall provide the permittee a revocation hearing and prior notice thereof. Such hearings shall be conducted in accordance with IDAPA 58.01.23, “Rules of Administrative Procedure Before the Board of Environmental Quality.”

(3-15-02)

04. Revocation and Closure. A permittee shall perform the closure requirements in a permit, the closure requirements of these rules, and complete all closure plan activities notwithstanding the revocation of the permit.

(4-7-11)

9.2.4 Violations (IDAPA 58.01.17.930)

Any person violating any provision of these rules or any permit or order issued thereunder shall be liable for a civil penalty not to exceed ten thousand dollars (\$10,000) or one thousand dollars (\$1,000) for each day of a continuing violation, whichever is greater. In addition, pursuant to Title 39, Chapter 1, Idaho Code, any willful or negligent violation may constitute a misdemeanor.

(4-1-88)

9.2.5 Severability

The provisions of this permit are severable, and if a provision or its application is declared invalid or unenforceable for any reason, that declaration will not affect the validity or enforceability of the remaining provisions.

10. Other Applicable Laws

DEQ may refer enforcement of the following provisions to the state agency authorized to enforce that rule. The permittee shall comply with all applicable provisions identified in this section. Compliance with this permit does not relieve the permittee from applicable requirements in other federal, state, and local laws, statutes, and rules.

10.1 Owner Responsibilities for Well Use and Maintenance

10.1.1 Well Use

The well owner must not operate any well in a manner that causes waste or contamination of the ground water resource. Failure to operate, maintain, knowingly allow the construction of any well in a manner that violates these rules, or failure to repair or properly decommission (abandon) any well as herein required will subject the well owner to civil penalties as provided by statute. See IDAPA 37.03.09.036.01 and consult the Idaho Department of Water Resources (IDWR) for more information.

10.1.2 Well Maintenance


The well owner must maintain the well to prevent waste or contamination of ground waters through leaky casings, pipes, fittings, valves, pumps, seals, or through leakage around the outside of the casings, whether the leakage is above or below the land surface. Any person owning or controlling a noncompliant well must have the well repaired by a licensed well driller under a permit issued by the IDWR director according to the applicable rules. See IDAPA 37.03.09.036.02 and consult IDWR for more information.

10.1.3 Wells Posing a Threat to Human Health and Safety or Causing Contamination of the Ground Water Resource

The well owner must have any well shown to pose a threat to human health and safety or cause contamination of the ground water resource immediately repaired or decommissioned (abandoned) by a licensed well driller under a permit issued by the IDWR director according to the applicable rules. See IDAPA 37.03.09.036.06 and consult IDWR for more information.

11. Site Maps

11.1 Regional Map

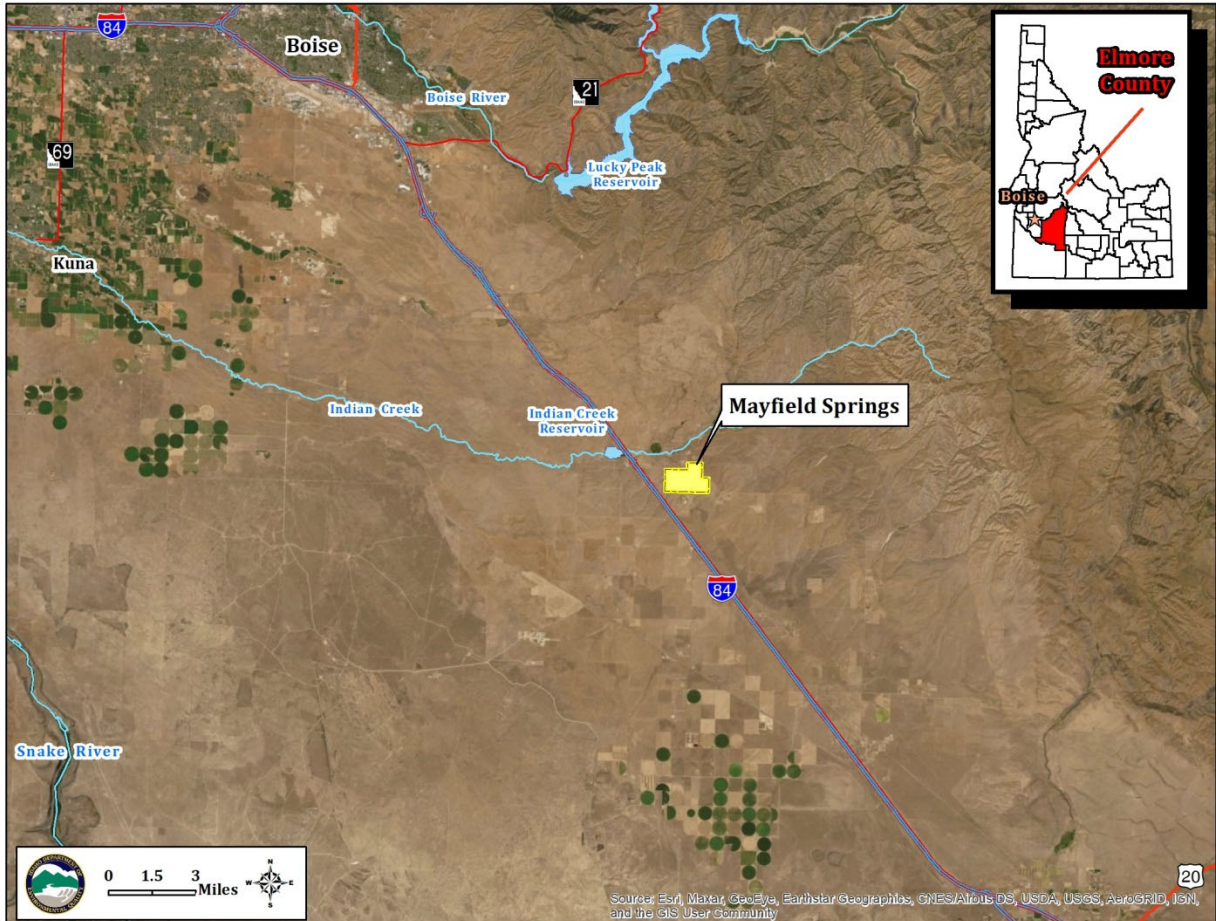

11.2 Facility Map

