
Idaho Department of Environmental Quality
Reuse Permit
I-050-04

(Previous Permit No. I-050-03)

Amalgamated Sugar Company (ASC), Mini-Cassia Facility (hereafter "permittee") is hereby authorized to construct, install, and operate a reuse facility in accordance with (1) this permit; (2) IDAPA 58.01.17 "Recycled Water Rules"; (3) an approved plan of operation; (4) IDAPA 58.01.14 "Rules Governing Fees for Environmental Operating Permits, Licenses, and Inspection Services"; and (5) all other applicable federal, state, and local laws, statutes, and rules. This permit is effective from the date of November 1, 2026 and expiration date of November 1, 2034.



Signature

10/08/2026

Date

Sue Switzer
Regional Administrator
Twin Falls Regional Office
Idaho Department of Environmental Quality

Idaho Department of Environmental Quality
Twin Falls Regional Office
650 Addison Avenue West, Suite 110
Twin Falls, Idaho 83301
(208) 736-2190

Accessibility Services: The Idaho Department of Environmental Quality will provide reasonable language access services and/or disability services for documents at no charge. To request an accommodation under Title VI of the Civil Rights Act of 1964 or Americans with Disabilities Act, contact DEQ's nondiscrimination coordinator at (208) 373-0271 or *accessibility@deq.idaho.gov*. Para obtener información en español, visite *https://www.deq.idaho.gov/about-us/accessibility/*.

This page intentionally left blank for correct double-sided printing.

Table of Contents

1. Common Acronyms/Abbreviations and Definitions 5
2. Facility Information 8
3. Compliance Schedule for Required Activities 9
4. Permit Limits and Conditions 14
4.1 Hydraulic Management Unit Descriptions 14
4.2 Hydraulic Loading Limits 15
4.3 Constituent Loading Limits 16
4.4 Management Unit Buffer Zones 17
4.5 Other Permit Limits and Conditions 17
5. Monitoring Requirements 19
5.1 Recycled Water and Supplemental Irrigation Water Sampling and Analyses 19
5.1.1 Constituent Monitoring 19
5.1.2 Management Unit and Other Flow Monitoring 19
5.2 Ground Water Monitoring 22
5.2.1 Ground Water Monitoring Point Descriptions 22
5.2.2 Ground Water Monitoring, Sampling, and Analyses 24
5.3 Soil Monitoring 24
5.3.1 Soil Monitoring Unit Descriptions 24
5.3.2 Soil Monitoring, Sampling, and Analyses 26
5.4 Crop Monitoring 27
5.4.1 Crop Harvest Monitoring 27
5.4.2 Plant Tissue Monitoring 27
5.5 Lagoon Information 28
6. Reporting Requirements 29
6.1 Annual Report Requirements 29
6.1.1 Due Date 29
6.1.2 Required Contents 29
6.1.3 Submittals 31
6.2 Emergency and Noncompliance Reporting 33
7. Permit for Use of Industrial Recycled Water 34
8. Standard Permit Conditions 34
9. General Permit Conditions 36
9.1 Operations 36
9.1.1 Backflow Prevention 36
9.1.2 Restricted to Premises 36
9.1.3 Solids Management 37
9.1.4 Temporary Cessation of Operations and Closure (IDAPA 58.01.17.801) 38
9.1.5 Plan of Operation (IDAPA 58.01.17.300.05) 38
9.1.6 Seepage Testing Requirements (IDAPA 58.01.16.493.02.c) 38
9.1.7 Ground Water Quality Rule (IDAPA 58.01.11) 38

9.1.8 Reuse Permit Fees (IDAPA 58.01.14.170.02) 38
9.2 Administrative 39
9.2.1 Permit Modification (IDAPA 58.01.17.700) 39
9.2.2 Permit Transferable (IDAPA 58.01.17.800) 39
9.2.3 Permit Revocation (IDAPA 58.01.17.920) 39
9.2.4 Severability 40
10. Other Applicable Laws 41
10.1 Owner Responsibilities for Well Use and Maintenance 41
10.1.1 Well Use 41
10.1.2 Well Maintenance 41
10.1.3 Wells Posing a Threat to Human Health and Safety or Causing Contamination of the Ground Water Resource 41
11. Site Maps 42
11.1 Regional Map 42
11.2 Facility Map 43

1. Common Acronyms/Abbreviations and Definitions

CA	compliance activity
COD	chemical oxygen demand
crop uptake	those constituents assimilated by the crop from the soil, and those from applied fertilizer, biosolids and other soil amendments, recycled water, irrigation water, and other sources. Crop uptake excludes those constituents assimilated from the atmosphere, such as gaseous nitrogen fixed by legumes. Crop uptake plus atmospheric assimilated constituents equals crop content.
cwt	a unit of weight measurement equal to 100 pounds
DEQ	Idaho Department of Environmental Quality
DEQ Guidance	*Guidance for Reclamation and Reuse of Municipal and Industrial Wastewater,* latest revision.
director	DEQ director or designee unless otherwise specified
EPA	United States Environmental Protection Agency
FM	prefix for flow measurement/monitoring location, device, or method reporting serial number
E_i	irrigation efficiency
FM	prefix for flow measurement/monitoring location, device, or method reporting serial number
GW	prefix for ground water reporting serial number
IDAPA	Numbering designation for all administrative rules in Idaho promulgated according to the Idaho Administrative Procedure Act
IDWR	Idaho Department of Water Resources
IWR	irrigation water requirement - any combination of wastewater and supplemental irrigation water applied at rates commensurate to the moisture requirements of the crop, and calculated monthly during the growing season (GS). The equation used to calculate the IWR is: $IWR = P_{def}/E_i$
lb	pound
LG	prefix for lagoon reporting serial number

material change	a change in a document required by this permit that would impact DEQ's ability to ensure compliance and protect human health and the environment
µmhos/cm	micromhos per centimeter
MG	million gallons
mg/kg	milligram per kilogram
mg/L	milligram per liter
mL	milliliter
MU	management unit, prefix for management unit reporting environmental serial number
NPDES	National Pollutant Discharge Elimination System
N	nitrogen
ppm	parts per million
P	phosphorus
PCC	Precipitated Calcium Carbonate
P_{def}	precipitation deficit - is synonymous with the net irrigation water requirement of the crop and for the purposes of this permit can be found at the following website: https://et-idwr.idaho.gov/
PO	plan of operation
QAPP	quality assurance project plan
responsible official	facility contact person authorized by the permittee to communicate with DEQ on behalf of the permittee on any matter related to the permit, including without limitation, the authority to communicate with and receive notices from DEQ regarding notices of violation or non-compliance, permit violations, permit enforcement, and permit revocation. The responsible official provides written certification of permit application materials, annual report submittals, and other information submitted to DEQ as required by the permit. Any notice to or communication with the responsible official is considered a notice to or communication with the permittee. The responsible official may designate an authorized representative to act as the facility contact person for any of the activities or duties related to the permit, except signing and certifying the permit application, which must be done by the responsible official. The authorized representative must act as the responsible official and will bind the permittee as described in this definition. Designation of the authorized representative must follow the requirements specified in section 6.1.3 of the permit.

SU	prefix for soil monitoring unit reporting serial number
SW	prefix for supplemental irrigation water reporting serial number
ASC	Amalgamated Sugar Company
WW	prefix for wastewater reporting serial number
yr	year

2. Facility Information

Information Type	Information Specific to This Permit
Type(s) of recycled water	Industrial recycled water from sugar beet processing.
Method of treatment and reuse	- Direct reuse (condensate wastewater) - Clarification, cooling, settling, and aeration (process wastewater) - Lagoon storage and evaporation - Slow rate land application
Facility location	50 South 500 West Paul, ID 83347 T9S, R23E, Sec. 21, 22, 25, 26, 27, 34
Facility mailing address	P.O. Box 700 Paul, Idaho 83347
Facility responsible official and authorized representative	Responsible Official: Current Vice President of Operations 208-383-6500 Authorized Representative(s): Current Plant Manager Current Assistant Plant Manager 208-438-2115 Notify DEQ within 30 days if a change in personnel occurs for any of the facility contacts. DEQ will issue a minor permit modification to confirm the change.
Groundwater	Site: Shallow aquifer groundwater table, 4-29 feet below ground surface, flow direction is predominantly to the north with localized northeast and northwest vectors. Regional: The regional aquifer occurs in underlying basalt with a static water level between 150 to 300 feet below ground surface and a westerly flow direction. Beneficial uses: Principal groundwater uses are public water supply, domestic and commercial, and agricultural.
Surface water	Snake River: Five miles south of facility. Beneficial uses: cold water biota, primary contact recreation C Canal: 50 ft north of lagoons. Beneficial uses: agriculture Main Drain: 60 ft north of facility. Beneficial uses: agriculture

3. Compliance Schedule for Required Activities

Compliance Activity (CA) Number and Completion Due Date	Compliance Activity Description
CA-050-01 Twelve (12) months after permit issuance	**Plan of Operation (PO)**: The permittee must submit to DEQ for review and approval a PO that reflects current operations and incorporates the requirements of this permit. The PO must comply with the applicable requirements stated in IDAPA 58.01.17.300.05 and must address applicable items in the most current Plan of Operations Checklist available. The PO must include the following site management plans, or the permittee may submit the site management plans individually: 1. Buffer zone plan; 2. Cropping plan; 3. Emergency operating plan; 4. Grazing management plan (as applicable); 5. Irrigation management and scheduling plan; 6. Nuisance and odor management plan; 7. Runoff management plan; 8. Well location acceptability analysis; 9. Waste solids management plan; 10. Precipitated calcium carbonate (PCC) storage area management plan; 11. Dust suppression plan (as applicable) The PO must be updated as needed to reflect current operations. The permittee must notify DEQ of material changes to the PO and copies must be kept on site and made available to DEQ upon request.

Compliance Activity (CA) Number and Completion Due Date	Compliance Activity Description
CA-050-02 Nine (9) months after permit issuance	**Quality Assurance Project Plan (QAPP)**: The permittee must prepare and implement a QAPP that incorporates all monitoring and reporting required by this permit. A copy of the QAPP along with written notice that the permittee has implemented the QAPP must be provided to DEQ. The Permittee must follow the QAPP when collecting, analyzing, and reporting monitoring data submitted to DEQ. The QAPP must be designed to assist in planning for collecting, analyzing, and reporting all monitoring in support of this permit and in explaining data anomalies when they occur. At a minimum, the QAPP must include the following: 1. Details on the number of measurements, number of samples, type of sample containers, preservation of samples, holding times, analytical methods, analytical detection and quantitation limits for each target compound, type and number of quality assurance field samples, precision and accuracy requirements, sample preparation requirements, sample shipping methods, and laboratory data delivery requirements 2. Maps indicating the location of each monitoring and sampling point 3. Qualification and training of personnel 4. Names, addresses, and telephone numbers of the laboratories used by or proposed to be used by the permittee 5. Example formats and tables that will be used by the permittee to summarize and present all data in the annual report The format and content of the QAPP should adhere to the recommendations and references in the Quality Assurance and Data Processing sections of the reuse guidance. The permittee must amend the QAPP whenever there is a modification in sample collection, sample analysis, or other procedure addressed by the QAPP. The permittee must notify DEQ of material changes to the QAPP and copies must be kept on site and made available to DEQ upon request.

<table>
<tr><th>Compliance Activity (CA) Number and Completion Due Date</th><th>Compliance Activity Description</th></tr>
<tr><td>CA-050-03
As specified</td><td>
Seepage Testing: The following table shows the date by which the permittee must complete seepage testing on the specified lagoons:
<table>
<tr><th>Lagoon:</th><th>Seepage Test Due Date:</th></tr>
<tr><td>LG-050-08</td><td>2031</td></tr>
<tr><td>LG-050-11</td><td>Prior to use</td></tr>
<tr><td>LG-050-12</td><td>Prior to use</td></tr>
<tr><td>LG-050-13</td><td>2033</td></tr>
<tr><td>LG-050-14</td><td>2033</td></tr>
</table>
Submit to DEQ for review and approval a proposed schedule and procedure for performing the required seepage tests at least 45 days before to the planned seepage test. The seepage test procedures must be sealed by the Idaho licensed professional engineer or professional geologist in responsible charge for the test.

Seepage tests must be completed according to the procedures approved by DEQ. The seepage test report must be sealed by the person in responsible charge and submitted within 90 days after completion of the seepage test.

Allowable seepage rates can be found in the table below. Requirements for lagoons leaking above the allowable amount are outlined in IDAPA 58.01.16.493.04 and should be used for these lagoons if found to be leaking above the allowable rate specified below.
<table>
<tr><th>Lagoon:</th><th>Allowable Seepage Rate (inches/day):</th></tr>
<tr><td>LG-050-08</td><td>0.25</td></tr>
<tr><td>LG-050-11</td><td>0.125</td></tr>
<tr><td>LG-050-12</td><td>0.125</td></tr>
<tr><td>LG-050-13</td><td>0.125</td></tr>
<tr><td>LG-050-14</td><td>0.125</td></tr>
</table>
</td></tr>
</table>

Compliance Activity (CA) Number and Completion Due Date	Compliance Activity Description
CA-050-04 As specified	**Dust Suppressant Characterization Study**: Within 18 months of the approval of the dust suppressant plan in compliance activity, CA-050-01, the permittee must conduct a dust suppressant characterization study that includes the following items: 1. Defined as management unit(s) (MUs): Any areas and respective acreage where application of condensate wastewater takes place for dust suppression purposes. 2. Monitor for 12 consecutive months and report the daily volume of condensate (and other water sources if used) applied to each MU defined in Item 1. Report hydraulic loading in million gallons/month and inches/acre-month. 3. Calculate and report the constituent loading of chemical oxygen demand, total nitrogen, and non-volatile dissolved solids on each MU in lb/acre-month and lb/acre-year. Use constituent concentrations obtained as specified in section 5.1.1 of the permit. 4. Sample the soils in each MU defined in Item 1 using the same sampling protocols specified in section 5.3.2 of the permit. Sampling events must be conducted in March and September. 5. The facility must submit the study to DEQ for review and approval. The study must include the following: a. The results of all monitoring conducted in Items 1 through 4. b. A proposed plan for conducting dust suppression activities using condensate wastewater that includes an appropriate loading rate and tracking procedures for the practice. c. An evaluation of potential groundwater impacts from the proposed plan in Item 5b and justification for the proposed activity.

Compliance Activity (CA) Number and Completion Due Date	Compliance Activity Description
CA-050-05 Plan due six (6) months from permit issuance Report due twelve (12) months after approval of the Plan	**Determine Aquifer Properties:** The permittee must submit a plan for DEQ's review and approval that characterizes hydraulic conductivity and gradient for all management units and groundwater monitoring wells. The plan must specify methodology, timing of aquifer testing, and seasonal low and high-water levels. An aquifer properties characterization report must be submitted to DEQ for review and approval within 12 months after approval of the plan.
CA-050-06 Plan due nine (9) months after approval of CA-050-05	**Nonvolatile Dissolved Solids (NVDS) Loading Assessment:** The permittee must submit an NVDS loading assessment to DEQ for review and approval that includes the following: 1. Projected NVDS loading rates, for the next ten (10) reporting years, for each management unit specified in section 4.1 that include NVDS contributions from wastewater and supplemental irrigation water. 2. An assessment of ground water quality impacts resulting from both the future NVDS loading rates estimated in item 1 and the total NVDS loading rates that would occur if recycled water NVDS loading rates are maintained at the current NVDS loading limit specified in section 4.3 of this permit. The updated aquifer properties from CA-049-05 will be used to complete this assessment. After reviewing the plan, DEQ will determine if the current NVDS loading limits specified in section 4.3 of the draft permit sufficiently protect ground water quality and recommend NVDS loading limits.
CA-050-07 One (1) year before permit expiration	**Pre-Application Workshop:** If the permittee intends to continue operating the reuse facility beyond the expiration date of this permit, the permittee must contact DEQ and schedule a pre-application workshop to discuss the compliance status of the facility and the content required for the reuse permit application package.
CA-050-08 Six (6) months before permit expiration	**Renewal Permit Application:** The permittee must submit to DEQ a complete permit renewal application package, which fulfills the requirements specified at the pre-application workshop identified in CA-050-07.

4. Permit Limits and Conditions

4.1 Management Unit Descriptions

Serial Number	Description	Irrigation System Type and Irrigation Efficiency	Maximum Acres[a] Allowed
MU-050-01	East Farm	Hand/Wheel Lines: (Ei = 0.75)	25
MU-050-02	South Farm	Hand/Wheel Lines: (Ei = 0.75)	27
MU-050-03[b]	Wilkins	Hand/Wheel Lines: (Ei = 0.75)	160
MU-050-04	Goitiandia	Hand/Wheel Lines: (Ei = 0.75)	87
MU-050-05	East Gillette	Hand/Wheel Lines: (Ei = 0.75)	89
MU-050-07	Seedall	Hand/Wheel Lines: (Ei = 0.75)	35
MU-050-08[b]	West Gillette	Pivot/Wheel Lines: (Ei = 0.75)	156
MU-050-09	South Schow	Pivot/Hand/Wheel Lines: (Ei = 0.75)	65
MU-050-10	North Schow	Pivot/Hand Line: (Ei = 0.75)	155
MU-050-11	West PCC Storage Area	Hand Lines: (Ei = 0.75)	23
MU-050-12	Center PCC Storage Area	Hand Lines: (Ei = 0.75)	15
MU-050-13	East PCC Storage Area	Hand Lines: (Ei = 0.75)	19
MU-050-14	South Suchan	Hand/Wheel Lines: (Ei = 0.75)	102
MU-050-15	Whitecar	Hand/Wheel Lines: (Ei = 0.75)	62
		Total on site acreage	647
		Total off site acreage	316
		Total PCC storage acreage	57
		Total acreage	1020

a. Maximum acres represent the total permitted acreage of the MU as provided by the permittee. If the permittee uses less acreage in any season or year, then loading rates must be presented and compliance must be determined based on the actual acreage utilized during each season or year.
b. Off-site management unit approved for condensate water application only.

4.2 Hydraulic Loading Limits

Serial Number	Growing Season Hydraulic Loading	Nongrowing Season Maximum Hydraulic Loading, inches[a]
MU-050-01	Substantially at the irrigation water requirement (IWR)[b]	5.8
MU-050-02	Substantially at the IWR[b]	6.4
MU-050-03	Substantially at the IWR[b]	8.0
MU-050-04	Substantially at the IWR[b]	8.0
MU-050-05	Substantially at the IWR[b]	8.0
MU-050-07	Substantially at the IWR[b]	6.1
MU-050-08	Substantially at the IWR[b]	8.0
MU-050-09	Substantially at the IWR[b]	5.9
MU-050-10	Substantially at the IWR[b]	7.2
MU-050-11	39.8 inches[c]	Not allowed[d]
MU-050-12		
MU-050-13		
MU-050-14	Substantially at the IWR[b]	6.2
MU-050-15	Substantially at the IWR[b]	7.9

a. Record daily, as necessary, abnormal conditions as a result of nongrowing season application including ponding, excessive ice buildup, or runoff from the permitted site.
b. For compliance purposes, the source of P_{def} data used to calculate the IWR must be specified in the PO.
c. Irrigation will be conducted in accordance with the DEQ approved PCC Storage Area Management Plan
d. Not allowed, unless approved by DEQ in a PCC Storage Area Management Plan.

4.3 Constituent Loading Limits

Serial Number	Constituent Loading (from all sources)			
	Nitrogen (lb/acre)	**Salt (NVDS) (lb/acre)[a, e]**	**COD growing season (lb/acre-day)[b]**	**COD non-growing season (lb/acre-day)[b]**
MU-050-01	150% of typical crop uptake[c,d]	1200	50	25
MU-050-02	150% of typical crop uptake[c,d]	1000	50	25
MU-050-03	150% of typical crop uptake[c,d]	642	50	25
MU-050-04	150% of typical crop uptake[c,d]	1900	50	25
MU-050-05	150% of typical crop uptake[c,d]	1900	50	25
MU-050-07	150% of typical crop uptake[c,d]	1600	50	25
MU-050-08	150% of typical crop uptake[c,d]	642	50	25
MU-050-09	150% of typical crop uptake[c,d]	2200	50	25
MU-050-10	150% of typical crop uptake[c,d]	1500	50	25
MU-050-11	No Limit[f]			
MU-050-12				
MU-050-13				

MU-050-14	150% of typical crop uptake[c,d]	1900	50	25
MU-050-15	150% of typical crop uptake[c,d]	2000	50	25

a. Loading rate from recycled process and condensate wastewater only. Contribution from supplemental irrigation water (SIW) has been factored into the limits shown.
b. COD limits are expressed in pounds per acre per day (lb/acre-day) based on a seasonal average.
c. Typical crop uptake is the median constituent crop uptake from the three most recent years the crop has been grown. For crops having less than three years of on-site crop uptake data, other crop yield data or nutrient content values may only be used if approved in writing by DEQ in advance of use. If written approval is not provided by DEQ, compliance with the 150% nitrogen loading limit must be determined by comparing the current year nitrogen loading to the current year nitrogen uptake.
d. For nitrogen-fixing crops, defined here as legumes, it will be assumed that 85% of nitrogen in the crop tissue came from crop uptake. Other values for nitrogen fixation may be used if DEQ provides written approval before use.
e. Unless otherwise stated in NVDS Loading Assessment to be created under compliance activity, CA-050-06.
f. No limit unless otherwise stated in the PCC Storage Area Management Plan.

4.4 Management Unit Buffer Zones

At a minimum, all buffer zones must comply with local zoning ordinances. Existing buffer zones must be maintained and assessed, pending approval of the updated PO (CA-050-01) required in section 3. Buffer zones must be managed and maintained according to the DEQ-approved buffer zone management plan.

4.5 Other Permit Limits and Conditions

Category	Permit Limits and Conditions
Growing season	April 1 through October 31 (214 days)
Nongrowing season	November 1 through March 31 (151 days)
Reporting year for annual loading rates	November 1 through October 31
Crop or vegetation allowed	Crops not grown for direct human consumption.
Grazing	Grazing is not allowed.
Posting	In accordance with the buffer zone plan.
Fencing	In accordance with the buffer zone plan.

Category	Permit Limits and Conditions
Construction plans	Pursuant to Idaho Code §39-118, IDAPA 58.01.16, and IDAPA 58.01.17, detailed plans and specifications must be submitted to DEQ for review and approval prior to construction, modification, or expansion of any wastewater treatment, storage, conveyance structures, groundwater monitoring wells, or reuse facility. Inspection requirements must be satisfied and within 30 days of completion of construction, the permittee must submit as-built plans or a letter from an Idaho Professional Engineer certifying the facilities or structures were constructed in substantial accordance with the approved plans and specifications.
Backflow prevention and testing requirements	Backflow prevention is required to protect surface water and groundwater from an unauthorized discharge of recycled water or wastewater. Refer to section 9.1.1 of this permit.
Records retention requirements	Keep records generated to meet the requirements of this permit for the duration of permit, including administrative extensions, plus 2 years.
PCC Storage Areas, MU-050-11 MU-050-12 MU-050-13	Recycled process wastewater application will be conducted in accordance to the DEQ approved Precipitated Calcium Carbonate Management Plan. The requirements specified in sections 4 and 5 of this permit will be superseded if different from the requirements contained in the management plan.

5. Monitoring Requirements

5.1 Recycled Water and Supplemental Irrigation Water Sampling and Analyses

5.1.1 Constituent Monitoring

Monitoring Point Serial Number and Location	Sample Description	Sample Type and Frequency	Constituents (Units in mg/L Unless Otherwise Specified)
WW-050-01 Process Water	Recycled process water to MU-050-01, MU-050-02, MU-050-04, MU-050-05, MU-050-07, MU-050-09, MU-050-10, MU-050-14, and MU-050-15	24-hour composite each month during periods of application	- Total nitrogen, as N - Total phosphorus, as P - Non-volatile dissolved solids - Chemical oxygen demand - Chloride - pH
WW-050-02 Condensate water	Recycled condensate water to MU-050-01, MU-050-02, MU-050-03, MU-050-04, MU-050-05, MU-050-07, MU-050-08, MU-050-09, MU-050-10, MU-050-14, and MU-050-15	24-hour composite each month during periods of application	- Total nitrogen, as N - Total phosphorus, as P - Non-volatile dissolved solids - Chemical oxygen demand - Chloride - pH
WW-050-03 Process and/or Condensate water	Recycled water to PCC storage areas MU-050-11, MU-050-12, and MU-050-13	Monthly grab sample during application	- Total nitrogen, as N - Non-volatile dissolved solids - Chemical oxygen demand
SW-050-01 C Canal	Supplemental irrigation water	Grab sample (May, July, and September) First and eighth permit year	- Total nitrogen, as N - Non-volatile dissolved solids

5.1.2 Management Unit and Other Flow Monitoring

Name	Facility Pump #	Flow Measurement Serial Number	Location	Sample Description	Sample Type and Frequency	Measured Parameters, each MU or FM
Flume Excess Flow Meter	87L-3	FM-050-01	North side of Flume Excess pond	Recycled process water flow to each specified management unit	- Daily meter reading - Monthly compilation of data	- Volume (MG/month) - Application depth (inches/month)
Condensate Surge Flow Meter	87L-6	FM-050-02	East side of Surge Pond	Recycled process water flow to each specified management unit	- Daily meter reading - Monthly compilation of data	- Volume (MG/month) - Application depth (inches/month)
West/East Lagoon Flow Meter	87L-7	FM-050-03	Between East and West Lagoons	Recycled condensate water flow to each specified management unit	- Daily meter reading - Monthly compilation of data	- Volume (MG/month) - Application depth (inches/month)
South Lagoon Flow Meter	87L-11	FM-050-04	East side of South Lagoon	Recycled condensate water flow to each specified management unit	- Daily meter reading - Monthly compilation of data	- Volume (MG/month) - Application depth (inches/month)
NE Lagoon Flow Meter	87L-9	FM-050-05	South side of NE Lagoon	Recycled condensate water flow to each specified management unit	- Daily meter reading - Monthly compilation of data	- Volume (MG/month) - Application depth (inches/month)
NW Lagoon Flow Meter	87L-10	FM-050-06	South side of NW Lagoon	Recycled condensate water flow to each specified management unit	- Daily meter reading - Monthly compilation of data	- Volume (MG/month) - Application depth (inches/month)

Name	Facility Pump #	Flow Measurement Serial Number	Location	Sample Description	Sample Type and Frequency	Measured Parameters, each MU or FM
FGD Flow Meter	84-P1	FM-050-07	Underneath FGD Clarifier	Recycled process and/or condensate water to PCC management areas	- Daily meter reading - Monthly compilation of data	- Volume (MG/month) - Application depth (inches/month)
SE Lagoon Flow Meter	87-L13	FM-050-08	North side of SE Lagoon	Recycled condensate water and/or cooling tower water flow to each specified management unit	- Daily meter reading - Monthly compilation of data	- Volume (MG/month) - Application depth (inches/month)
Seedall Farm (MU-050-07) Flow Meter	87F-4	FM-050-09	SE Corner of MU-07	Supplemental irrigation water to each specified management unit	- Daily meter reading - Monthly compilation of data	- Volume (MG/month) - Application depth (inches/month)
South Farm (MU-050-02) Flow Meter	87F-5	FM-050-10	South side of MU-02	Supplemental irrigation water to each specified management unit	- Daily meter reading - Monthly compilation of data	- Volume (MG/month) - Application depth (inches/month)
South Schow (MU-050-09) Flow Meter	87F-6	FM-050-11	North side of MU-09	Supplemental irrigation water to each specified management unit	- Daily meter reading - Monthly compilation of data	- Volume (MG/month) - Application depth (inches/month)
North Schow South (MU-050-10) Flow Meter	87F-7	FM-050-12	SE Corner of MU-10	Supplemental irrigation water to each specified management unit	- Daily meter reading - Monthly compilation of data	- Volume (MG/month) - Application depth (inches/month)

Name	Facility Pump #	Flow Measurement Serial Number	Location	Sample Description	Sample Type and Frequency	Measured Parameters, each MU or FM
North Schow North (MU-050-10) Flow Meter	87F-8	FM-050-13	North side of MU-10	Supplemental irrigation water to each specified management unit	- Daily meter reading - Monthly compilation of data	- Volume (MG/month) - Application depth (inches/month)
Goitiandia (MU-050-04)	87F-9	FM-050-14	South side of MU-04	Supplemental irrigation water to each specified management unit	- Daily meter reading - Monthly compilation of data	- Volume (MG/month) - Application depth (inches/month)
East Gillette (MU-050-05)	87F-10	FM-050-15	South side of MU-05	Supplemental irrigation water to each specified management unit	- Daily meter reading - Monthly compilation of data	- Volume (MG/month) - Application depth (inches/month)
South Suchan (MU-050-14)	87F-12	FM-050-17	South end of border between MU-02 and MU-13	Supplemental irrigation water to each specified management unit	- Daily meter reading - Monthly compilation of data	- Volume (MG/month) - Application depth (inches/month)

5.2 Groundwater Monitoring

5.2.1 Groundwater Monitoring Point Descriptions

Monitoring Point Serial Number	Common Designation	Well Type	Gradient Location
GW-050-24	107	Monitoring well	Midgradient between Goitiandia and Gillette East
GW-050-25	108	Monitoring well	Midgradient south of East Farm and Seedall
GW-050-33	H	Monitoring well	Upgradient East Farm
GW-050-34	I	Monitoring well	Downgradient South Farm
GW-050-35	J	Monitoring well	Upgradient South Farm

GW-050-39	N	Monitoring well	Upgradient PCC storage area
GW-050-50	109	Monitoring well	Upgradient Seedall and South Schow
GW-050-52	112	Monitoring well	Midgradient north of East Gillette
GW-050-54	Seedall	Monitoring well	Downgradient Seedall
GW-050-59	M	Monitoring well	Downgradient PCC Storage area
GW-050-60	C	Monitoring well	Midgradient between west and northwest lagoons
GW-050-63	114	Monitoring well	Upgradient South Schow
GW-050-64	115	Monitoring well	Downgradient South Schow Upgradient North Schow
GW-050-65	116	Monitoring well	Upgradient North Schow
GW-050-66	117	Monitoring well	Downgradient North Schow
GW-050-67	118	Monitoring well	Downgradient North Schow
GW-050-68	119	Monitoring well	Sidegradient North Schow
GW-050-69	120	Monitoring well	Downgradient Goitiandia
GW-050-70	121	Monitoring well	Downgradient Gillette East
GW-050-71	122	Monitoring well	Upgradient South Suchan
GW-050-72	123	Monitoring well	Downgradient South Suchan
GW-050-73	E-R	Monitoring well	Downgradient of Southeast lagoons
GW-050-74	124	Monitoring well	Upgradient of East Farm
GW-050-75	125	Monitoring well	Downgradient of East Farm

5.2.2 Groundwater Monitoring, Sampling, and Analyses

Monitoring Point Serial Number	Sampling Point Description	Sample Type and Frequency	Constituents (Units in mg/L Unless Otherwise Specified)
All groundwater monitoring points in section 5.2.1	Monitoring wells	Field measurement twice annually: April and October	- Water table elevation (feet) - Water table depth (feet) - pH (Standard units) - Specific conductance/ (µmhos/cm) - Temperature (°C) - Dissolved oxygen
		Unfiltered grab sample/twice annually (unless otherwise specified): April and October	- Nitrate-nitrogen, as N - Total dissolved solids - Total iron[a] - Total manganese[a]
All required groundwater monitoring wells; WW-050-01; WW-050-02; LG-050-01; LG-050-03; LG-050-05, LG-050-06; LG-050-07; LG-050-08; LG-050-09; LG-050-10; LG-050-11; LG-050-12; LG-050-13; LG-050-14; SW-050-01	Monitoring wells; process wastewater, condensate wastewater; lagoons; supplemental irrigation water	Unfiltered grab sample/twice annually: April and October, during the first and sixth year of the permit	- Sodium - Potassium - Calcium - Magnesium - Sulfate - Chloride - Carbonate/bicarbonate

a. Analytical results are required for dissolved iron and manganese only if the results for total iron and manganese exceed the standard in IDAPA 58.01.11.200.01.b

5.3 Soil Monitoring

5.3.1 Soil Monitoring Unit Descriptions

Monitoring Point Serial Number	Description	Associated Management Unit
SU-050-01	East Farm	MU-050-01

Monitoring Point Serial Number	Description	Associated Management Unit
SU-050-02	South Farm	MU-050-02
SU-050-03	Wilkins	MU-050-03
SU-050-05	Goitiandia	MU-050-04
SU-050-06	Gillette East	MU-050-05
SU-050-11	Seedall	MU-050-07
SU-050-08	Gillette West	MU-050-08
SU-050-09	South Schow	MU-050-09
SU-050-10	North Schow	MU-050-10
SU-050-12	Manning Area	N/A (mud storage area)
SU-050-13	West PCC Storage Area	MU-050-11
SU-050-14	Center PCC Storage Area	MU-050-12
SU-050-15	East PCC Storage Area	MU-050-13
SU-050-16	South Suchan	MU-050-14
SU-050-17	Whitecar	MU-050-15

5.3.2 Soil Monitoring, Sampling, and Analyses

Monitoring Point Serial Number	Sample Type	Sample Frequency	Constituents (Units in mg/kg Soil Unless Otherwise Specified)
SU-050-01 SU-050-02 SU-050-03 SU-050-05 SU-050-06 SU-050-11 SU-050-08 SU-050-09 SU-050-10 SU-050-12 SU-050-16 SU-050-17	Composite samples[a]	Annually, March	- Electrical conductivity (µmhos/cm in saturated paste extract) - Nitrate-nitrogen - Ammonium, as N - Plant available phosphorus - pH (standard units)
SU-050-13 SU-050-14 SU-050-15	Composite samples[b]	Prior to starting first application, after the first application, after every fourth subsequent application[b]	Moisture content, %

a. The number of sample locations specified in the PO or QAPP for each SU must be sampled. At each location, samples must be obtained from three depths: 0–12 inches; 12–24 inches; and 24–36 inches or refusal. The samples obtained from each depth must be composited by depth to yield three composite samples for each soil monitoring unit; one composite sample for each depth.
b. Sampling must be conducted in accordance with the PCC Storage Area Management Plan.

5.4 Crop Monitoring

5.4.1 Crop Harvest Monitoring

Associated Management Units	Sample Type	Sample Frequency	Parameters[a]
MU-050-01 MU-050-02 MU-050-04 MU-050-05 MU-050-07 MU-050-09 MU-050-10 MU-050-14 MU-050-15	Harvested portion, each crop, each MU	Each harvest	- Crop type - Harvest date - Sample collection date - Harvested acreage (acres) - As-harvested ('wet') yield in customary harvested units (tons, bushels, cwt, etc.). - As-harvested (field) moisture content (%)[b] - Dry yield (lb)

a. Documentation of reported yields must be provided for each harvest from each MU.
b. The field moisture must be monitored at the time the harvested crop is weighed.

5.4.2 Plant Tissue Monitoring

Associated Management Units	Sample Type	Sample Frequency	Parameters[a,b]
MU-050-01 MU-050-02 MU-050-04 MU-050-05 MU-050-07 MU-050-09 MU-050-10 MU-050-14 MU-050-15	Harvested portion, each crop, each harvest	Each harvest	-Lab moisture content (%); -Total combustible nitrogen (%); -Phosphorus, as P (ppm) -Ash (%)

a. Report dry-basis results for all parameters except lab moisture content.
b. The plant tissue sample must be taken from the harvested portion of each crop at the time the crop is harvested or just prior to harvesting.

5.5 Lagoon Information

Serial number	Description	Surface Area, acres	Maximum Operating Volume, MG	Liner Type
LG-050-01	Condensate surge pond	1	2	60 mil HDPE
LG-050-03	Three mud ponds	15	15	Bentonite
LG-050-05	Flume excess pond	9	22	Bentonite
LG-050-06	Northwest lagoon	18	73	60 mil HDPE
LG-050-07	Northeast lagoon	19	81	60 mil HDPE
LG-050-08	West lagoon	5.2	20	60 mil HDPE
LG-050-09	East lagoon	5.2	22	60 mil HDPE
LG-050-10	South lagoon	13.3	66	60 mil HDPE
LG-050-11	Southeast lagoon cell 1	13.5	50	60 mil HDPE
LG-050-12	Southeast lagoon cell 2	13.6	50	60 mil HDPE
LG-050-13	Sanitary lagoon cell 1	1	2	Bentonite
LG-050-14	Sanitary lagoon cell 2	1	2	Bentonite

6. Reporting Requirements

6.1 Annual Report Requirements

The permittee must submit to DEQ an annual report prepared by a competent environmental professional covering the previous reporting year.

6.1.1 Due Date

The annual report is due no later than **January 31** of each year, which must cover the previous reporting year.

6.1.2 Required Contents

The annual report must include the following:

1. Detailed results of the required monitoring as described in section 5 of this permit. The report must present all monitoring data in summary tables to expedite review. If the permittee monitors any parameter for compliance purposes more frequently than required by this permit, the results of this monitoring must be included in the calculation and reporting of the data submitted in the annual report.
2. A brief interpretive discussion of the results of all required monitoring data as specified by section 5. The discussion must address data quality objectives, validation, and verification; explain what the data say about permit compliance; and reuse facility environmental impacts. The reporting year for this permit is specified in section 4.5.
3. Status of all work described in section 3 of this permit.
4. Results of all backflow testing, repairs, and replacements required by section 9.1.1 of this permit.
5. Discussion of major maintenance activities such as major equipment replacement, lagoon liner maintenance, and wastewater treatment and reuse facility maintenance.
6. A summary of all noncompliance events that occurred during the reporting year. Examples of noncompliance events that must be discussed include, but are not limited to: exceedance of permit limits, complaints, missed monitoring events, incorrect monitoring dates or frequencies, dry monitoring wells, uncontained spills causing runoff, construction without DEQ engineering plan approval, construction without engineering inspection, and reporting incorrect acreage.
7. Laboratory analytical reports that show results, analytical methods, and practical quantitation limits for monitoring specified in section 5 of the permit. Chain of custody forms, supporting information for laboratory analytical reports, and quality assurance documentation must be available for review upon request by DEQ.
8. The calculations and results for the parameters in the following table:

Monitoring Point Serial Number	Parameter (Calculate for each MU)	Units
MU-050-01 MU-050-02 MU-050-04 MU-050-05 MU-050-07 MU-050-09 MU-050-10 MU-050-14 MU-050-15	Process wastewater, condensate wastewater, and supplemental irrigation water hydraulic loading rates	Million gallons/month Inches/month
	Irrigation water requirement (IWR) for each crop grown	Inches/month Inches/growing season
	COD loading rate: growing season seasonal average	Pounds/acre-day
	COD loading rate: nongrowing season seasonal average	Pounds/acre-day
	Recycled water nitrogen, phosphorus, and non-volatile dissolved solids loading rates	Pounds/acre-year
	Supplemental irrigation water nitrogen, and non-volatile dissolved solids loading rates	Pounds/acre-year
	Fertilizer nitrogen and phosphorus application rates, reported as elemental N and P	Pounds/acre-year
	Waste solids nitrogen and phosphorus application rates	Pounds/acre-year
	Crop harvest and yield Report each harvest and the annual totals for each MU.	Crop types harvested Total harvested area (acres) Total ‘wet’ yield (lb/yr, lb/acre-yr) Total ‘dry’ yield (lb/yr, lb/acre-yr)
	Crop nitrogen, phosphorus, and ash removal rates (dry-basis) Report each harvest and the annual totals for each MU.	Pounds-N/acre-year Pounds-P/acre-year Pounds Ash/acre-year

Monitoring Point Serial Number	Parameter (Calculate for each MU)	Units
MU-050-03 MU-050-08	Condensate water loading rate	Million gallons/month Inches/month
	COD loading rate: growing season seasonal average	Pounds/acre-day
	COD loading rate: nongrowing season seasonal average	Pounds/acre-day
	Condensate wastewater loading rates for nitrogen	Pounds/acre-year
MU-050-11 MU-050-12 MU-050-13	Process wastewater and condensate wastewater, hydraulic loading rates	Gallons/application for each irrigation zone Inches/application for each zone Annual gallons and inches for each application zone Annual gallons and inches for each management unit
	Application Period	Date(s) of each application
	Application Area	Irrigation zone and acres

6.1.3 Submittals

All applications, annual reports, or other information submitted to DEQ as required by this permit must be signed and certified as follows:

- Permit applications must be signed by the responsible official as described below:
  - For a corporation by a responsible corporate officer.
  - For a partnership or sole proprietorship by a general partner or the proprietor, respectively.
  - For a municipality, state, federal, Indian tribe, or other public agency by either the principal executive officer, ranking elected official, or a person of decision-making authority who can legally bind the permittee with respect to the permit.
- Annual reports and other information required by this permit must be signed by the responsible official or by a duly authorized representative of that person. A person is a duly authorized representative only if all of the following are true:
  - The authorization is made in writing by the responsible official.
  - The authorization specifies either an individual or position having responsibility for the overall operation of the regulated facility, such as the position of plant manager, superintendent, position of equivalent responsibility, or an individual having overall responsibility for environmental matters for the company.
  - The written authorization is submitted to DEQ.

Submit all applications, annual reports, and other information required by this permit to the following DEQ regional office at this address:

Engineering Manager
Idaho Department of Environmental Quality
Twin Falls Regional Office
650 Addison Avenue West, Suite 110
Twin Falls, Idaho 83301

The annual report, or any other data or monitoring information submitted to DEQ, must include the following certification statement and be signed, dated, and certified by the permittee's Responsible Official or duly Authorized Representative:

> *"I certify that the information provided in this submittal was prepared in conformance with the current Quality Assurance Project Plan and is to the best of my knowledge, true, accurate and complete and I acknowledge that knowing submission of false or incomplete information may result in permit revocation as provided for in IDAPA 58.01.17.920.01 or other enforcement action as provided for under Idaho law."*

Permit applications must include the following certification statement and be signed, dated, and certified by the permittee's Responsible Official:

> *"I certify that the information provided in this submittal is, to the best of my knowledge, true, accurate and complete and I acknowledge that knowing submission of false or incomplete information may result in permit revocation as provided for in IDAPA 58.01.17.920.01, non-issuance of the permit, or other enforcement action as provided for under Idaho law."*

Other information submitted to DEQ as required by the permit must include the above certification statement and be signed, dated, and certified by the permittee's Responsible Official or duly Authorized Representative.

6.2 Emergency and Noncompliance Reporting

Report noncompliance incidents to DEQ's regional office at (208) 736-2190, toll-free (800) 270-1663.

The permittee may also be required to report unauthorized discharges to surface waters to DEQ's IPDES program. The DEQ IPDES hotline is (833) IPDES24 or (833) 473-3724.

In case of public health emergencies, the permittee should call the 24-hour Idaho Emergency Medical Services Communications Center number at (800) 632-8000.

Section 8 of this permit and IDAPA 58.01.17.500.04 provide the reporting requirements for facilities.

The permittee must report all instances of permit non-compliance that may endanger public health or the environment and unauthorized discharges to surface waters of the State of Idaho to DEQ's regional office by telephone (phone numbers provided in this section) within 24 hours from the time the permittee becomes aware of these events at the phone numbers provided in this section.

The permittee must provide a written follow-up to the DEQ regional office within five days from the time the permittee became aware of the permit non-compliance or unauthorized discharge.

7. Permit for Use of Industrial Recycled Water

The following are permit requirements for industrial recycled water and are included as terms of this permit as required by a subsection of the "Recycled Water Rules," (IDAPA 58.01.17.608). Director refers to DEQ Director or designee unless otherwise specified.

608. PERMIT FOR INDUSTRIAL REUSE FACILITIES.

01. Requirements. Industrial wastewater or recycled water may only be used according to a permit issued pursuant to these rules. Permit conditions and limitations are developed by the Department on a case-by-case basis and take into account specific characteristics of the wastewater to be recycled and treatment needed to ensure recycled water use complies with IDAPA 58.01.11, "Ground Water Quality Rule," and IDAPA 58.01.02, "Water Quality Standards." The permit application, processing, and issuance procedures set forth in these rules apply to industrial reuse permits. (4-6-23)

8. Standard Permit Conditions

The following standard permit conditions are included as terms of this permit as required by the "Recycled Water Rules," (IDAPA 58.01.17.500).

500. STANDARD CONDITIONS.
Permit conditions will protect human health and the environment from the potential hazard of an existing or proposed wastewater treatment system. The permittee must comply with all conditions of the permit. The following conditions apply to and are included in all permits. (4-6-23)

01. Facility Operation. At all times, the permittee must properly maintain and operate all structures, systems, and equipment installed or used by the permittee for treatment, control, and monitoring to achieve compliance with the permit or these rules. (4-6-23)

02. Provide Information. If requested by the Department, the permittee must provide the Department, within a reasonable time, information including copies of records, to help the Department determine whether cause exists for modifying, revoking, re-issuing, or terminating the permit, or to determine compliance with the permit or these rules. (4-6-23)

03. Entry and Access. The permittee must allow the Department, consistent with Title 39, Chapter 1, Idaho Code, to: (4-6-23)

a. Enter the permitted facility and all associated property; (4-6-23)

b. Inspect any records kept under the conditions of the permit; (4-6-23)

c. Inspect and photograph any permitted facility, equipment, practice, records, or operation; and (4-6-23)

d. Sample or monitor any substance or any parameter at the facility to ensure permit compliance. (4-6-23)

04. Reporting. The permittee must report to the Department as specified in this section. (4-6-23)

a. A written report submitted at least thirty (30) days before: (4-6-23)

i. Any planned physical or operational alteration to the permitted facility that results or would result in a significant change in information submitted during the application process. If a major permit modification is needed, the alteration cannot be made before the Department issues approval. (4-6-23)

ii. Any anticipated change that would result in noncompliance with any permit condition or these rules. (4-6-23)

b. Orally within twenty-four (24) hours from the time the permittee became aware of any noncompliance that may endanger human health and the environment at telephone numbers provided in the permit. (4-6-23)

c. A written report as soon as possible, but within five (5) days of the date the permittee knows, or should reasonably know, of any noncompliance unless extended by the Department, providing: (4-6-23)

i. Description of the noncompliance and its cause; (4-6-23)

ii. Period of noncompliance including, to the extent possible, times and dates, if the noncompliance has not been corrected, and the anticipated length of time it is expected to continue; and (4-6-23)

iii. Steps taken or planned, including timelines, to reduce or eliminate the continuance or reoccurrence of the noncompliance. (4-6-23)

d. In writing as soon as the permittee knows, or should reasonably know, of material facts not submitted or corrections to information submitted in a permit application, report, or notice provided to the Department. (4-6-23)

e. No person may knowingly make any false statement, representation, or certification in any form, notice, or report required under any permit, or any applicable rule or order in force pursuant thereto. (4-6-23)

05. Minimize Impacts. The permittee must take all necessary actions to eliminate and correct any adverse impact on human health and the environment resulting from permit noncompliance. (4-6-23)

06. Applied Waters Restricted to Premises. Wastewater or recycled water applied to the land surface must be restricted to the premises of the reuse site. (4-6-23)

07. Hazard or Nuisance Prohibited. Wastewater or recycled water must not create a public health hazard or a nuisance condition. (4-6-23)

08. Renewal. If the permittee intends to continue operating the permitted facility after the existing permit expires, the permittee must apply for a permit renewal according to these rules. (4-6-23)

9. General Permit Conditions

The following general permit conditions are based on the cited rules at the time of issuance and are enforceable as part of this permit. Note that the rules cited in this section, and elsewhere in this permit, are supplemented by the rules themselves. Rules applicable to your facility are enforceable whether or not they appear in this permit.

9.1 Operations

9.1.1 Backflow Prevention

Reuse facilities with existing or planned cross-connections or interconnections between the recycled water system and any water supply (potable or nonpotable) or surface water, must have backflow prevention assemblies, devices, or methods as required by applicable rule or as specified in this permit and approved by DEQ.

For public water systems, backflow assemblies must meet the requirements of IDAPA 58.01.08.543. Assemblies must be adequately maintained and must be tested annually by a certified backflow assembly tester, and repaired or replaced as necessary to maintain operational status.

Domestic water and irrigation water supply wells must meet the requirements of IDAPA 37.03.09.36 for preventing any waste or contamination of the groundwater resource. Backflow prevention assemblies or devices used to protect the groundwater must be adequately operated and maintained.

Discharge of recycled water to surface water is regulated by the DEQ or EPA. An IPDES or NPDES permit is required for any discharge to surface water and backflow prevention must be implemented to prevent any unauthorized discharge. Backflow prevention assemblies or devices used to protect surface water must be adequately operated and maintained.

Records of all testable backflow assembly test results, repairs, and replacements must be kept at the reuse facility along with other operational records, and must be discussed in the annual report and made available for inspection by DEQ. Other approved means of backflow prevention, such as siphons and air-gap structures that cannot be tested, must be maintained in operable order.

9.1.2 Restricted to Premises

Wastewaters or recharge waters applied to the land surface must be restricted to the premises of the application site. Wastewater discharges to surface water require an IPDES or NPDES permit (IDAPA 58.01.16.600.02).

9.1.3 Solids Management

Biosolids are the nutrient-rich organic materials resulting from the treatment of sewage sludge. When treated and processed, sewage sludge becomes biosolids that can be safely recycled and applied as fertilizer to sustainably improve and maintain productive soils and stimulate plant growth.

Biosolids generated from sewage sludge are regulated by DEQ or EPA under 40 CFR Part 503 and require a DEQ-approved sludge disposal plan as outlined in IDAPA 58.01.16.650. Contact DEQ before to applying biosolids at any permitted reuse facility.

Sludge is the semi-liquid mass produced and removed by wastewater treatment processes. This does not include grit, garbage, and large solids.

Sludge may be generated by wastewater treatment processes at municipal and industrial facilities. A DEQ-approved sludge disposal plan, as outlined in IDAPA 58.01.16.650, may be required.

Solid waste is any garbage or refuse, sludge from a waste water treatment plant, water supply treatment plant, or air pollution control facility and other discarded material including solid, liquid, semi-solid, or contained gaseous material resulting from industrial, commercial, mining, and agricultural operations and from community activities, but does not include solid or dissolved materials in domestic sewage, or solid or dissolved material in irrigation return flows or industrial discharges that are point sources subject to permits under Section 402 of the Federal Water Pollution Control Act, as amended or source, special nuclear, or by-product material as defined by the Atomic Energy Act of 1954, as amended.

Solid waste does not include inert wastes, manures and crop residues ultimately returned to the soils at agronomic rates, and any agricultural solid waste that is managed and regulated pursuant to rules adopted by the Idaho Department of Agriculture. DEQ reserves the right to use existing authorities to regulate agricultural waste that impacts human health or the environment.

Solid waste is regulated under the “Solid Waste Management Rules” (IDAPA 58.01.06). Wastes otherwise regulated by DEQ (i.e., this permit) are not regulated under IDAPA 58.01.06.

Waste solids include sludge and wastes otherwise regulated by DEQ according with IDAPA 58.01.06.001.03.a.xii. Waste solids may include vegetative waste, silt and mud containing organic matter, and other non-inert solid wastes.

Inert wastes are defined as non-combustible, nonhazardous, and non-putrescible solid wastes that are likely to retain their physical and chemical structure and have a de minimis potential to generate leachate under expected conditions of disposal, which includes resistance to biological attack.

Waste solids require a DEQ-approved sludge disposal plan as outlined in IDAPA 58.01.16.650.

9.1.4 Temporary Cessation of Operations and Closure (IDAPA 58.01.17.801)

Temporary cessation of operations and closure must be addressed as follows:

01. Temporary Cessation. A permittee must implement any applicable conditions specified in the permit for temporary cessation of operations. When the permit does not specify applicable temporary cessation conditions, the permittee must notify the Department before a temporary cessation of reuse operations at the facility greater than sixty (60) days in duration and any cessation not for regular maintenance or repair. Cessation of operations necessary for regular maintenance or repair of a duration of sixty (60) days or less do not require Department notification under this section. Notification compliance under this section includes a proposed temporary cessation plan to ensure the cessation of operations will not pose a threat to human health and the environment. (4-6-23)

02. Closure. A closure plan is required when a facility is closed voluntarily and when a permit is revoked. A permittee implements any applicable conditions specified in the permit for facility closure. Unless otherwise directed by the terms of the permit or by the Department, the permittee submits a closure plan to the Department for approval at least ninety (90) days before ceasing operations. The closure plan ensures the closed facility will not pose a threat to human health and the environment. Closure plan approval may be conditioned upon a permittee's agreement to complete such site investigations, monitoring, and any necessary remediation activities. A permittee must complete all closure plan activities. (4-6-23)

9.1.5 Plan of Operation (IDAPA 58.01.17.300.05)

The PO must comply with the following:

05. Reuse Facility Plan of Operation. A plan of operation must contain, as applicable, operation and management responsibility, permits and standards, general plant description, operation and control of unit operations, reuse area site maps, wastewater and recycled water characterization, cropping plan, hydraulic loading rate, constituent loading rates, compliance activities, seepage rate testing, site management plans, monitoring, site operations and maintenance, solids handling and processing, laboratory testing, general maintenance, records and reports, store room and inventory, personnel, and an emergency operating plan. Permittees are required to submit a plan of operation for review and approval. Amendments are also subject to review and approval. (4-6-23)

9.1.6 Seepage Testing Requirements (IDAPA 58.01.16.493.02.c)

Subsequent Tests. All lagoons covered under these rules must be seepage tested by an Idaho licensed professional engineer, an Idaho licensed professional geologist, or by individuals under their supervision every ten (10) years after the initial testing. (3-31-22)

9.1.7 Ground Water Quality Rule (IDAPA 58.01.11)

The permittee must comply with the requirements of "Ground Water Quality Rule" (IDAPA 58.01.11).

9.1.8 Reuse Permit Fees (IDAPA 58.01.14.170.02)

Permitted reuse facilities must pay an annual fee according to requirements of the "Rules Governing Fees for Environmental Operating Permits, Licenses, and Inspection Services" (IDAPA 58.01.14).

9.2 Administrative

Requirements for administration of the permit are defined as follows.

9.2.1 Permit Modification (IDAPA 58.01.17.700)

01. Causes. A permit modification may be initiated by a permittee through a modification request or by the Department if one (1) or more of the following causes exist. (4-6-23)

a. Material and substantial alterations or additions to the permitted facility or activity occurred after permit issuance which justify applying permit conditions that are different or absent in the existing permit. (4-6-23)

b. Standards or regulations on which the permit was based amended by promulgation or by judicial decision after the permit was issued. (4-6-23)

c. The Department determines good cause exists for modifying a compliance schedule or terms and conditions of a permit. (4-6-23)

d. Level of discharge of any pollutant that is not limited in the permit exceeds the level that may cause an adverse impact to surface or ground waters. (4-6-23)

e. Correct technical mistakes, such as errors in calculation, or mistaken interpretations of law made in determining permit conditions. (4-6-23)

f. When a treatment technology proposed, installed, and properly operated and maintained by the permittee fails to achieve the requirements of the permit.

9.2.2 Permit Transferable (IDAPA 58.01.17.800)

01. General. A permit may be transferred only upon Department approval. No transfer is required for a corporate name change if the permittee, via secretary of state filings, can verify a change in name alone occurred. An attempted transfer is not effective until approved in writing by the Department. (4-6-23)

9.2.3 Permit Revocation (IDAPA 58.01.17.920)

01. Conditions. The Department may revoke a permit or coverage under a reuse general permit if the permittee violates any permit condition or these rules, or the Department becomes aware of any omission or misrepresentation of condition or information relied upon when issuing the permit. (4-6-23)

02. Notice. Except in emergencies, the Department will issue a written notice of intent to revoke to the permittee before final revocation. Revocation becomes final within thirty-five (35) days of the permittee receiving notice unless, within that time, the permittee requests an administrative hearing in writing. The hearing is conducted according to IDAPA 58.01.23, Contested Case Rules and Rules for Protection and Disclosure of Records. (4-6-23)

03. Emergency Action. If the Department finds the human health, safety, or welfare requires emergency action, the Department will incorporate findings to support the action and issue a written notice of emergency revocation to the permittee. Emergency revocation is effective upon receipt by the permittee. If requested by the permittee in writing, the Department will provide the permittee a revocation hearing. Hearings are conducted according to IDAPA 58.01.23, Contested Case Rules and Rules for Protection and Disclosure of Records. (4-6-23)

04. Revocation and Closure. A permittee must perform the closure requirements in a permit and these rules and complete all closure plan activities regardless of the permit revocation. (4-6-23)

9.2.4 Severability

The provisions of this permit are severable, and if a provision or its application is declared invalid or unenforceable for any reason, that declaration will not affect the validity or enforceability of the remaining provisions.

10. Other Applicable Laws

DEQ may refer enforcement of the following provisions to the state agency authorized to enforce that rule. The permittee must comply with all applicable provisions identified in this section. Compliance with this permit does not relieve the permittee from applicable requirements in other federal, state, and local laws, statutes, and rules.

10.1 Owner Responsibilities for Well Use and Maintenance

10.1.1 Well Use

The well owner must not operate any well in a manner that causes waste or contamination of the ground water resource. Failure to operate, maintain, knowingly allow the construction of any well in a manner that violates these rules, or failure to repair or properly decommission (abandon) any well as herein required will subject the well owner to civil penalties as provided by statute. See IDAPA 37.03.09.036.01 and consult the Idaho Department of Water Resources (IDWR) for more information.

10.1.2 Well Maintenance


The well owner must maintain the well to prevent waste or contamination of ground waters through leaky casings, pipes, fittings, valves, pumps, seals, or through leakage around the outside of the casings, whether the leakage is above or below the land surface. Any person owning or controlling a noncompliant well must have the well repaired by a licensed well driller under a permit issued by the IDWR director in accordance with the applicable rules. See IDAPA 37.03.09.036.02 and consult IDWR for more information.

10.1.3 Wells Posing a Threat to Human Health and Safety or Causing Contamination of the Ground Water Resource

The well owner must have any well shown to pose a threat to human health and safety or cause contamination of the ground water resource immediately repaired or decommissioned (abandoned) by a licensed well driller under a permit issued by the IDWR director in accordance with the applicable rules. See IDAPA 37.03.09.036.06 and consult IDWR for more information.

11. Site Maps

11.1 Regional Map

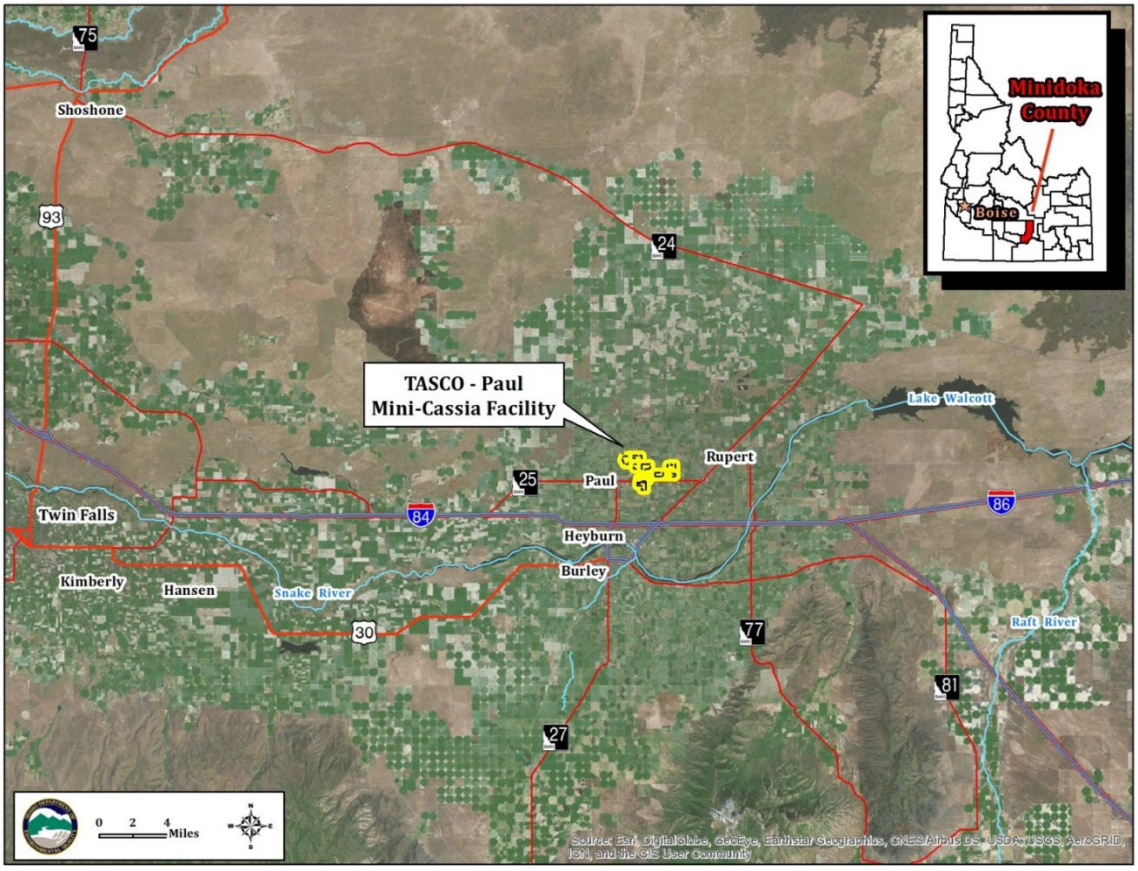

11.2 Facility Map

